



2011 Dissolved Arsenic Compliance Ratios (Base Flow)

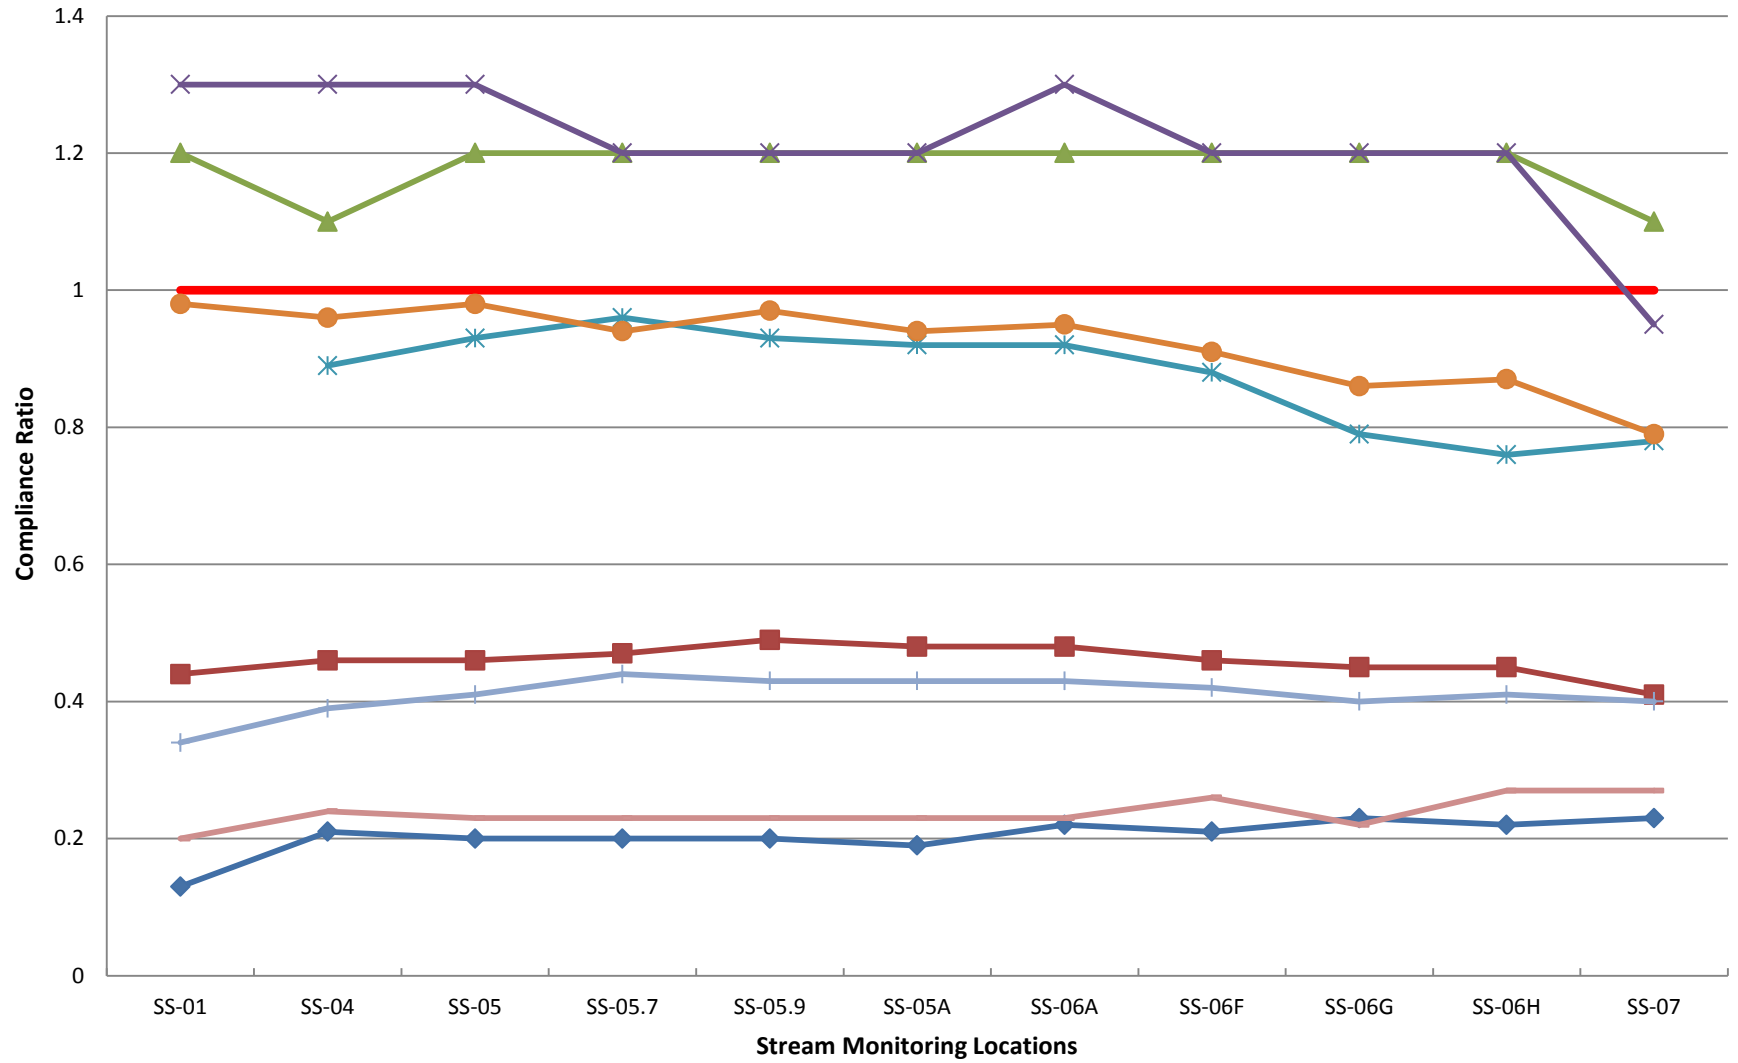


- HH Standard
- ◆— 2/3/2011
- 4/6/2011 Slightly Elevated Flow
- ▲— 6/28/2011 Elevated Flow
- ×— 7/6/2011 Elevated Flow
- *— 7/12/2011 Elevated Flow
- 7/19/2011 Elevated Flow
- +— 9/7/2011
- 12/1/2011

2011 Total Recoverable Arsenic Compliance Ratios (Base Flow)

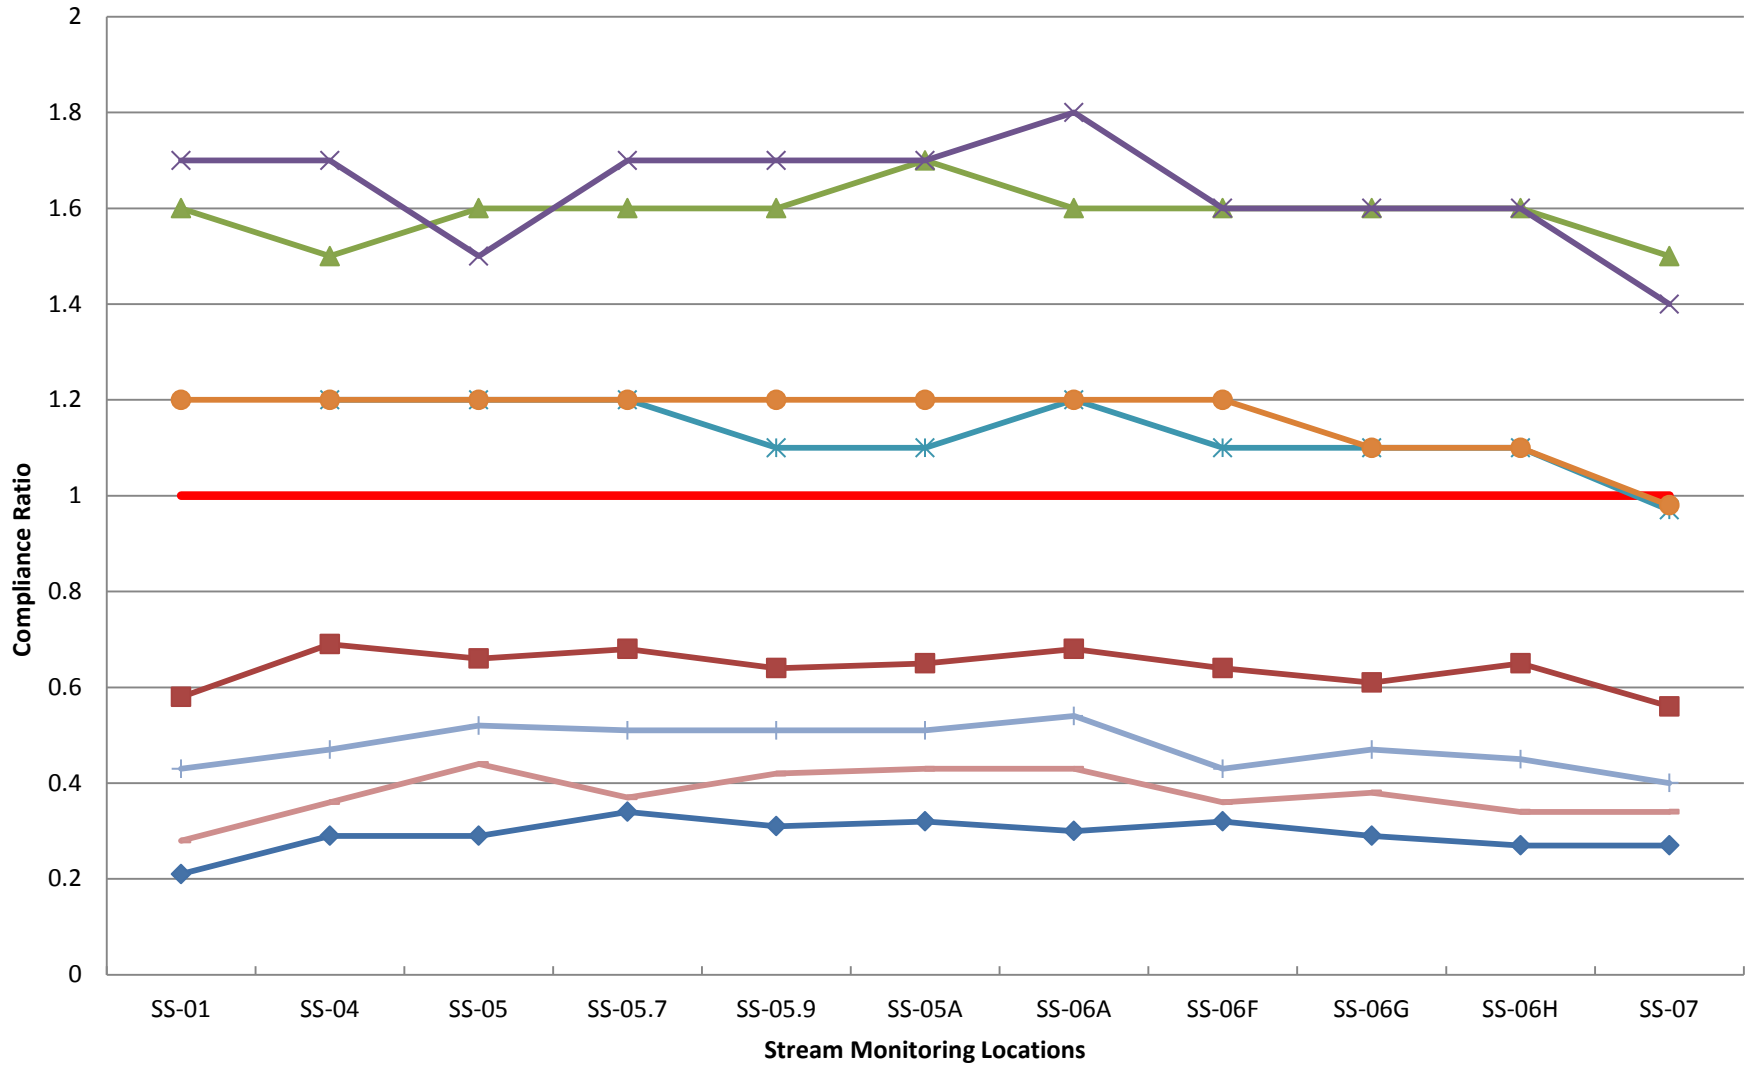


- HH Standard
- ◆— 2/3/2011
- 4/6/2011 Slightly Elevated Flow
- ▲— 6/28/2011 Elevated Flow
- ×— 7/6/2011 Elevated Flow
- *— 7/12/2011 Elevated Flow
- 7/19/2011 Elevated Flow
- +— 9/7/2011
- 12/1/2011

2011 Dissolved Cadmium Compliance Ratios (Base Flow)

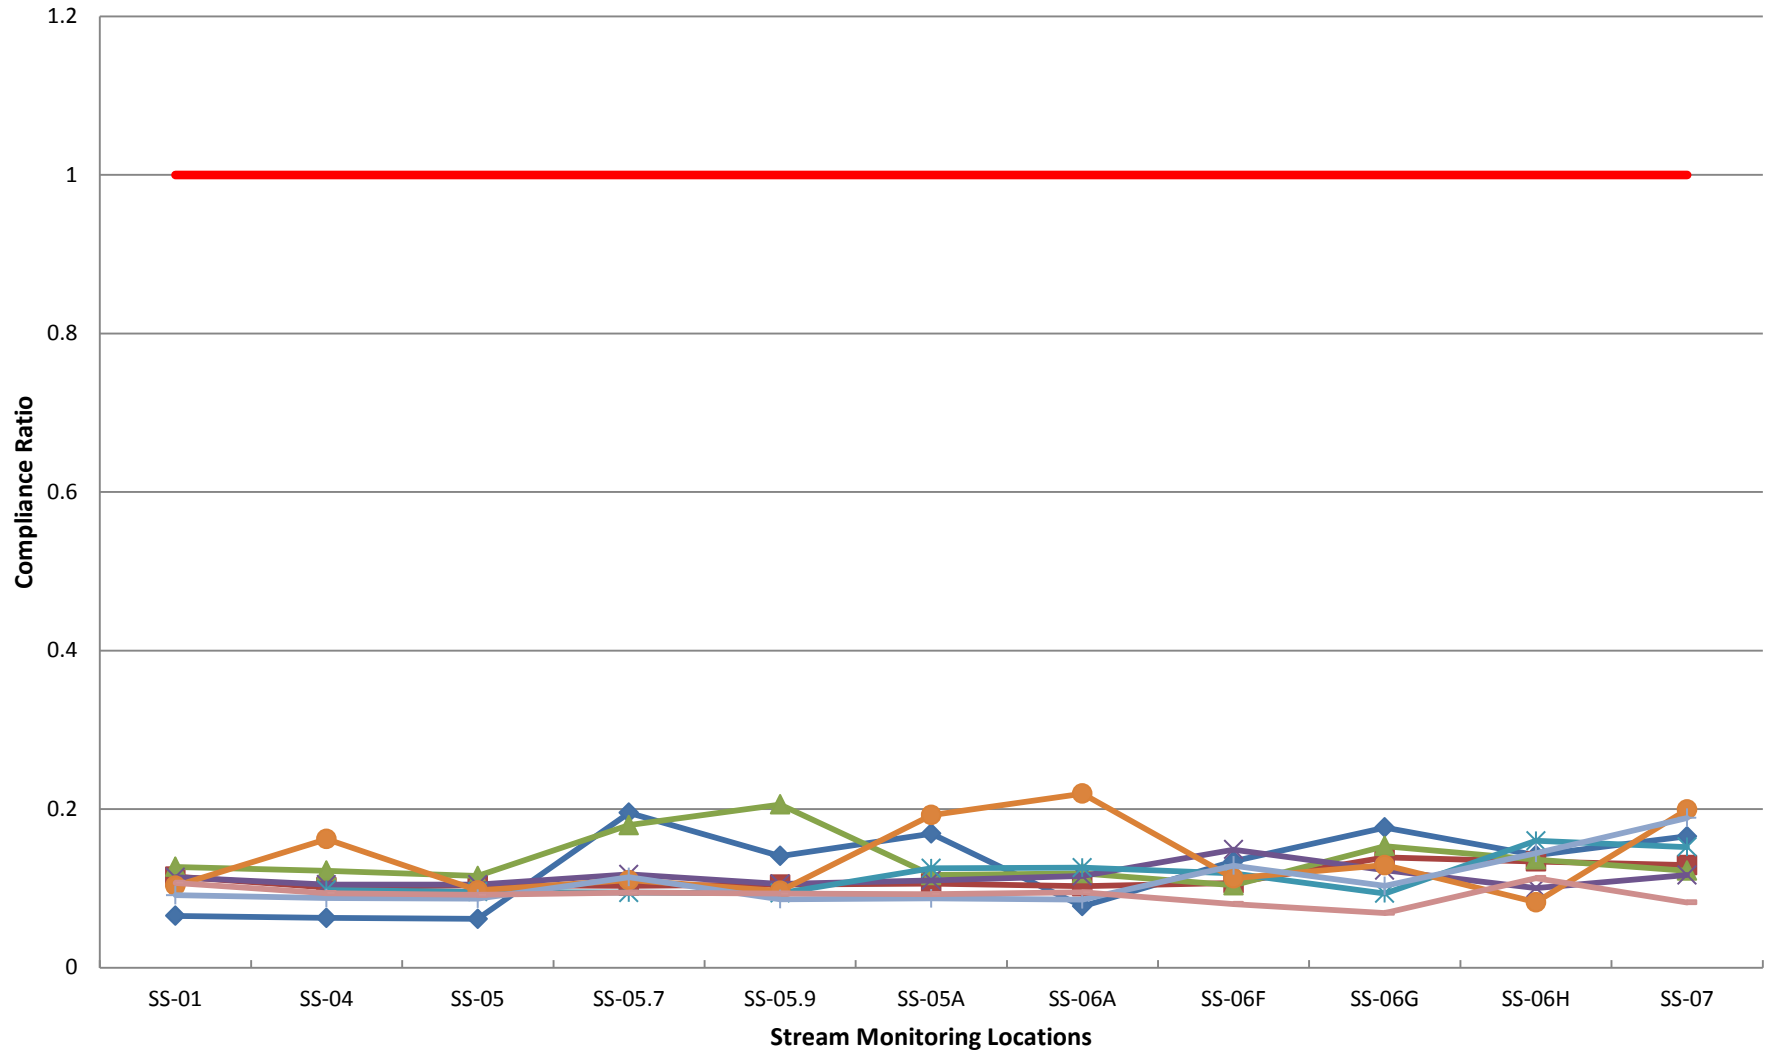


- ◆— Chronic Standard
- ▲— 6/28/2011 Elevated Flow
- 7/19/2011 Elevated Flow
- ◆— 2/3/2011
- ×— 7/6/2011 Elevated Flow
- +— 9/7/2011
- 4/6/2011 Slightly Elevated Flow
- *— 7/12/2011 Elevated Flow
- 12/1/2011

2011 Total Recoverable Cadmium Compliance Ratios (Base Flow)

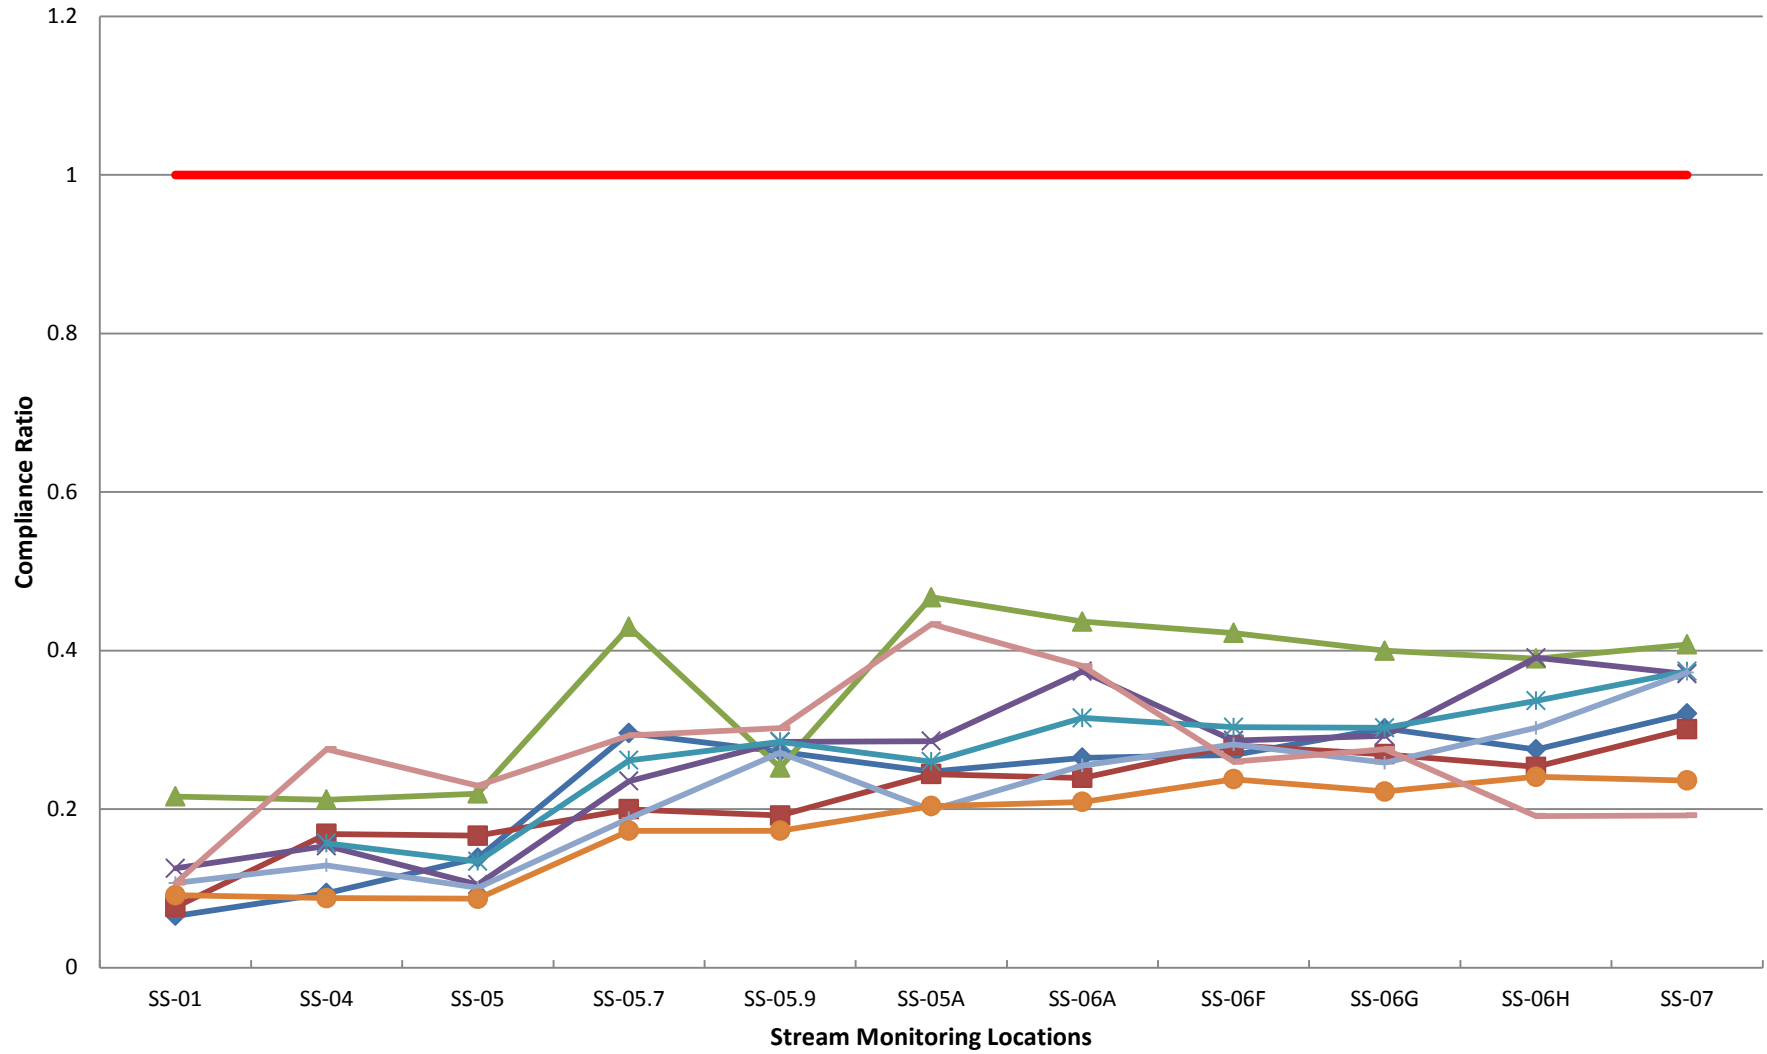


- Chronic Standard
- ▲ 6/28/2011 Elevated Flow
- ◆ 2/3/2011
- × 7/6/2011 Elevated Flow
- 4/6/2011 Slightly Elevated Flow
- ✱ 7/12/2011 Elevated Flow
- + 7/19/2011 Elevated Flow
- 9/7/2011
- 12/1/2011

2011 Dissolved Copper Compliance Ratios (Base Flow)

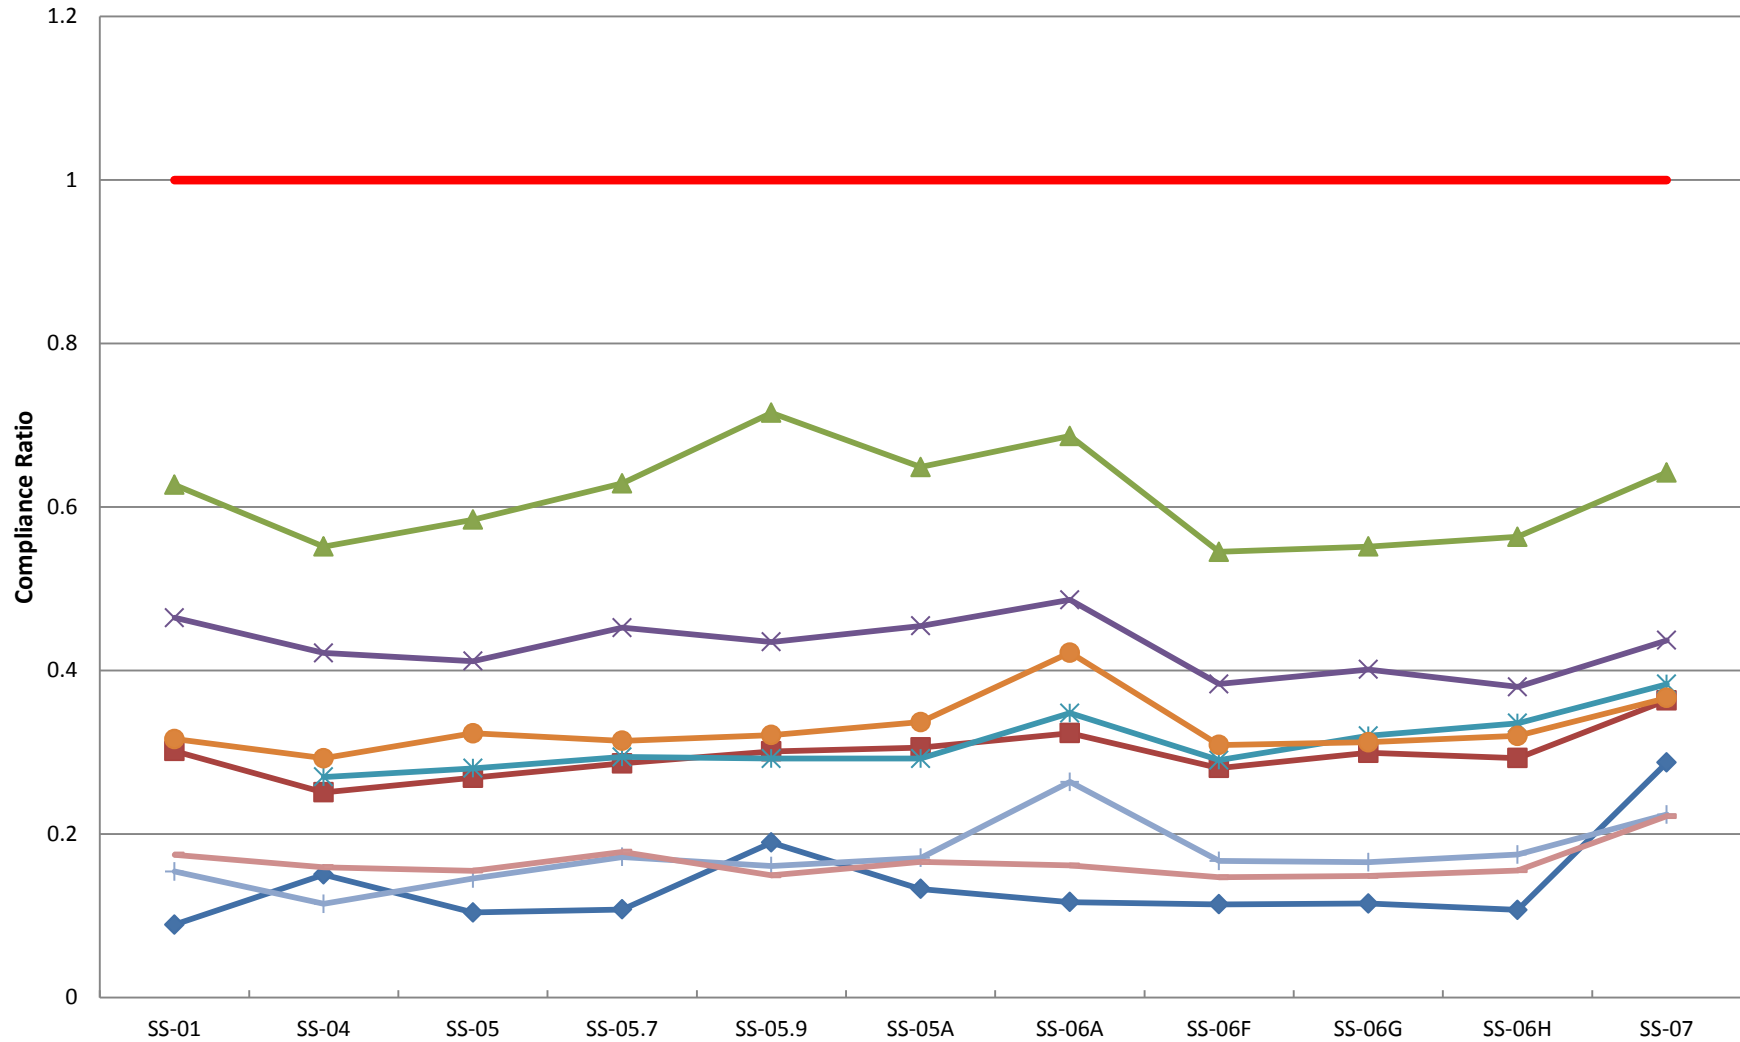


- ▲ Chronic Standard
- ▲ 6/28/2011 Elevated Flow
- 7/19/2011 Elevated Flow
- ◆ 2/3/2011
- × 7/6/2011 Elevated Flow
- + 9/7/2011
- 4/6/2011 Slightly Elevated Flow
- ✱ 7/12/2011 Elevated Flow
- 12/1/2011

2011 Total Recoverable Copper Compliance Ratios (Base Flow)

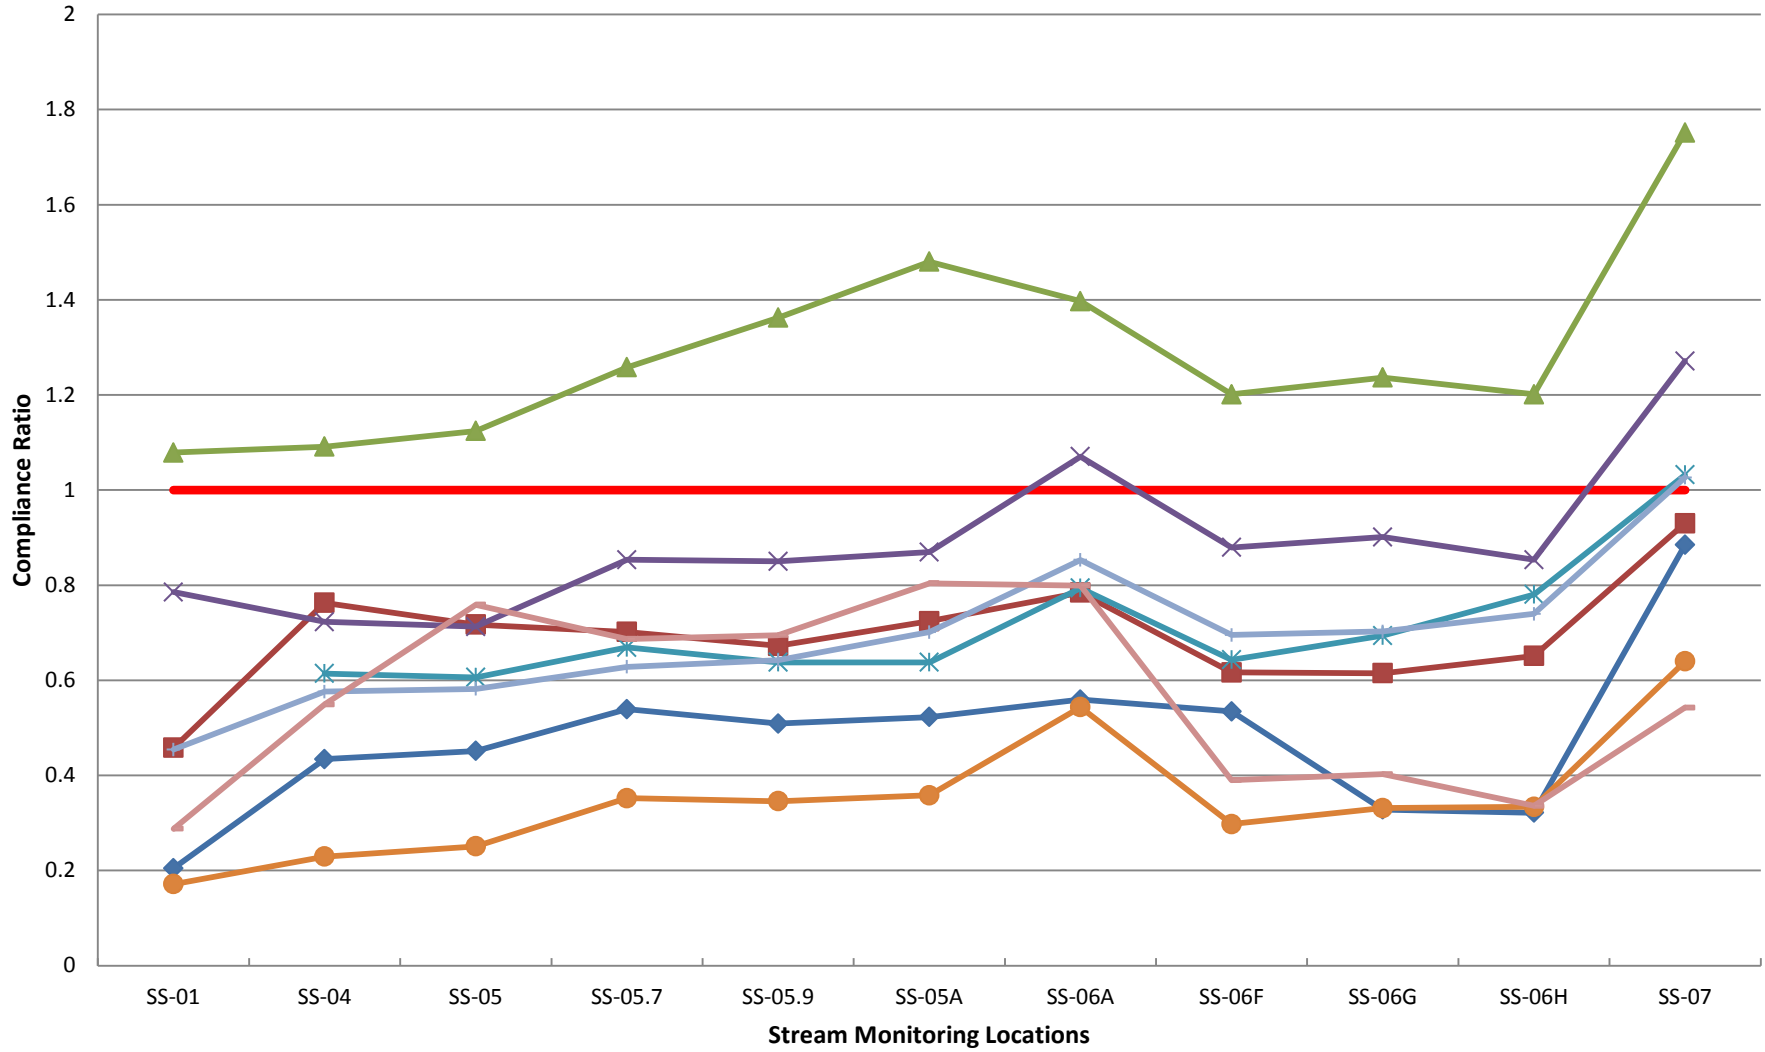


- Chronic Standard
- ▲ 6/28/2011 Elevated Flow
- ◆ 2/3/2011
- × 7/6/2011 Elevated Flow
- * 7/12/2011 Elevated Flow
- 4/6/2011 Slightly Elevated Flow
- + 7/19/2011 Elevated Flow
- 9/7/2011
- + 12/1/2011

2011 Dissolved Lead Compliance Ratios (Base Flow)

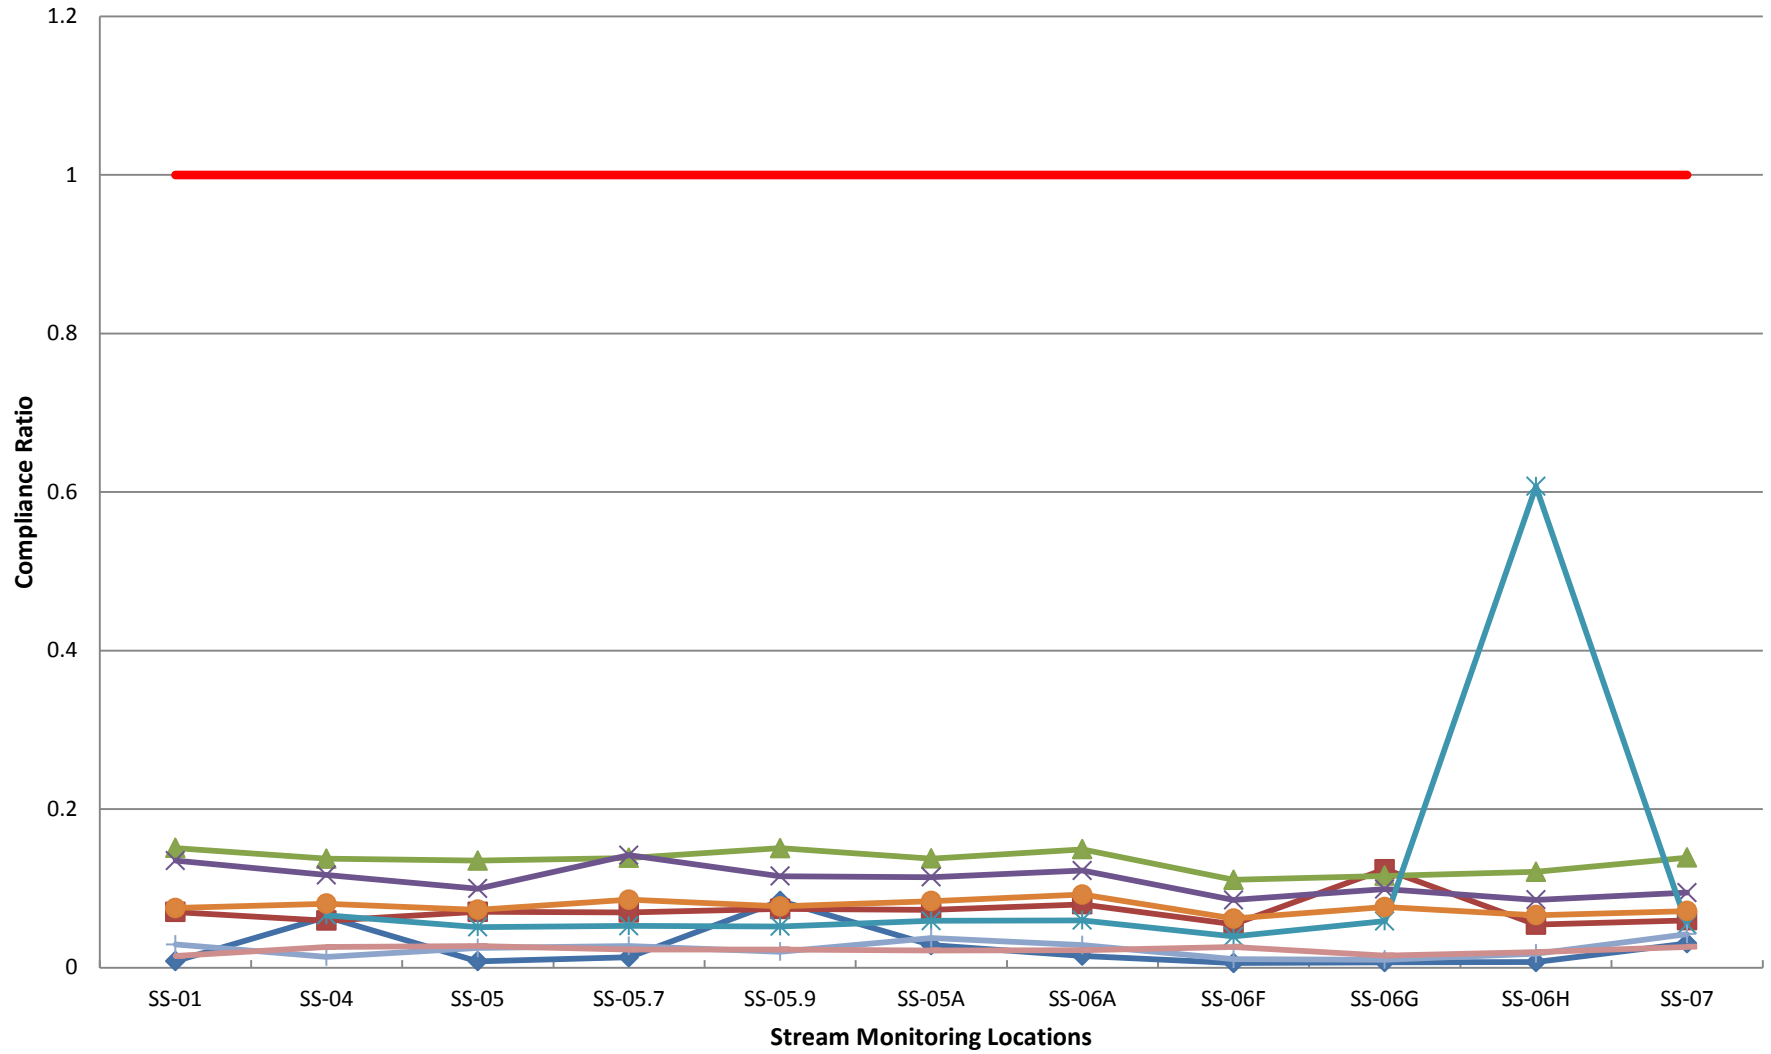


- Chronic Standard
- ▲ 6/28/2011 Elevated Flow
- 7/19/2011 Elevated Flow
- ◆ 2/3/2011
- × 7/6/2011 Elevated Flow
- + 9/7/2011
- 4/6/2011 Slightly Elevated Flow
- ✱ 7/12/2011 Elevated Flow
- 12/1/2011

2011 Total Recoverable Lead Compliance Ratios (Base Flow)

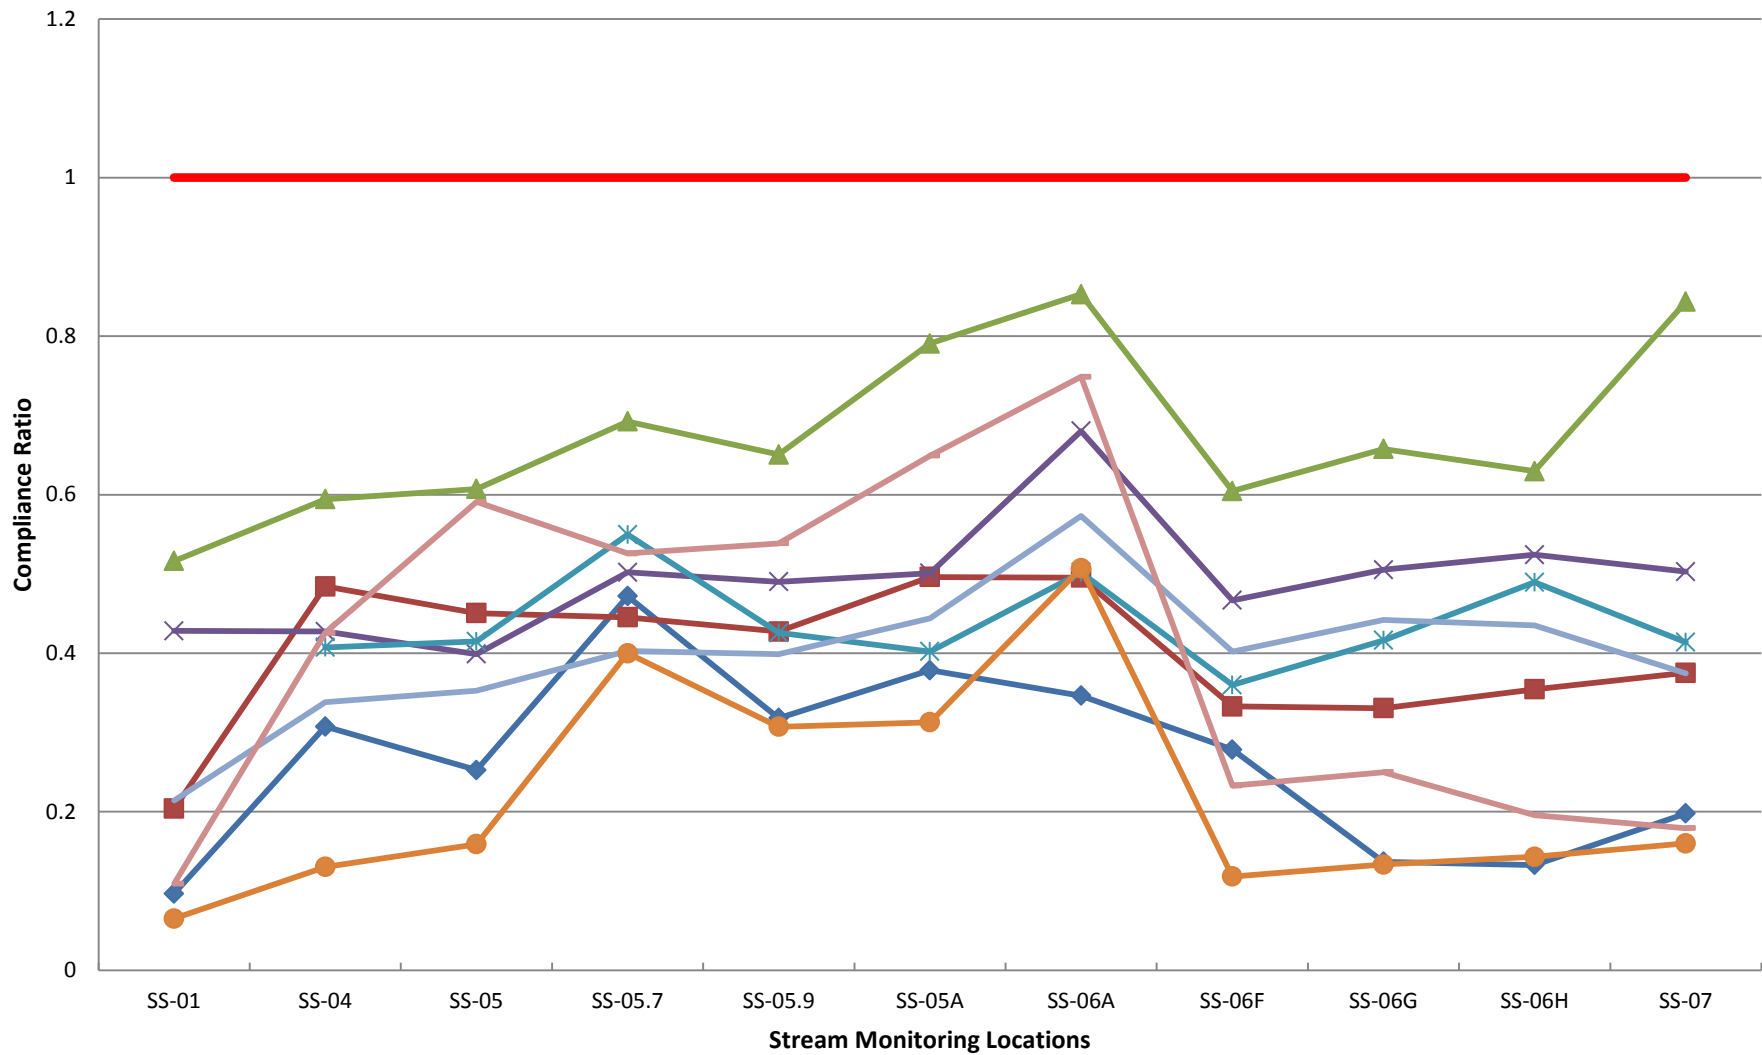


- Chronic Standard
- ▲ 6/28/2011 Elevated Flow
- ◆ 2/3/2011
- × 7/6/2011 Elevated Flow
- ✱ 7/12/2011 Elevated Flow
- 4/6/2011 Slightly Elevated Flow
- 7/19/2011 Elevated Flow
- 9/7/2011
- 12/1/2011

2011 Dissolved Zinc Compliance Ratios (Base Flow)

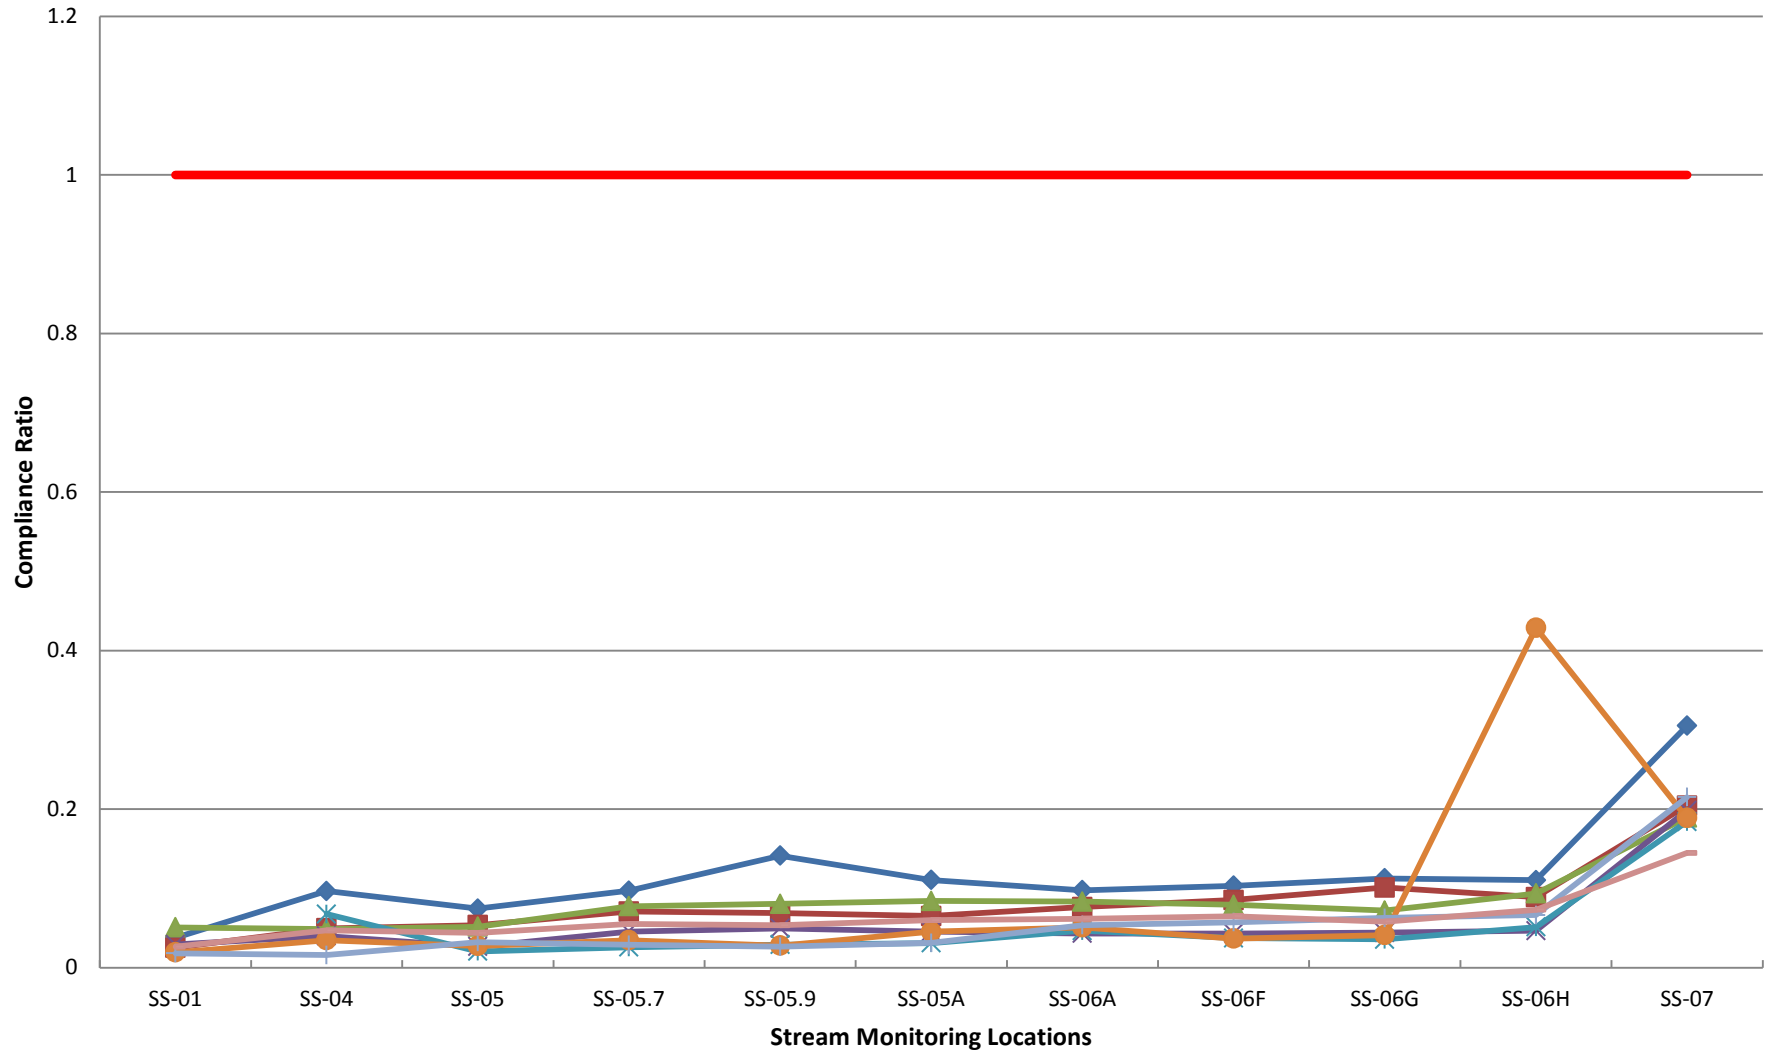

- Chronic Standard
- 6/28/2011 Elevated Flow
- 7/19/2011 Elevated Flow
- 2/3/2011
- 7/6/2011 Elevated Flow
- 9/7/2011
- 4/6/2011 Slightly Elevated Flow
- 7/12/2011 Elevated Flow
- 12/1/2011

2011 Total Recoverable Zinc Compliance Ratios (Base Flow)

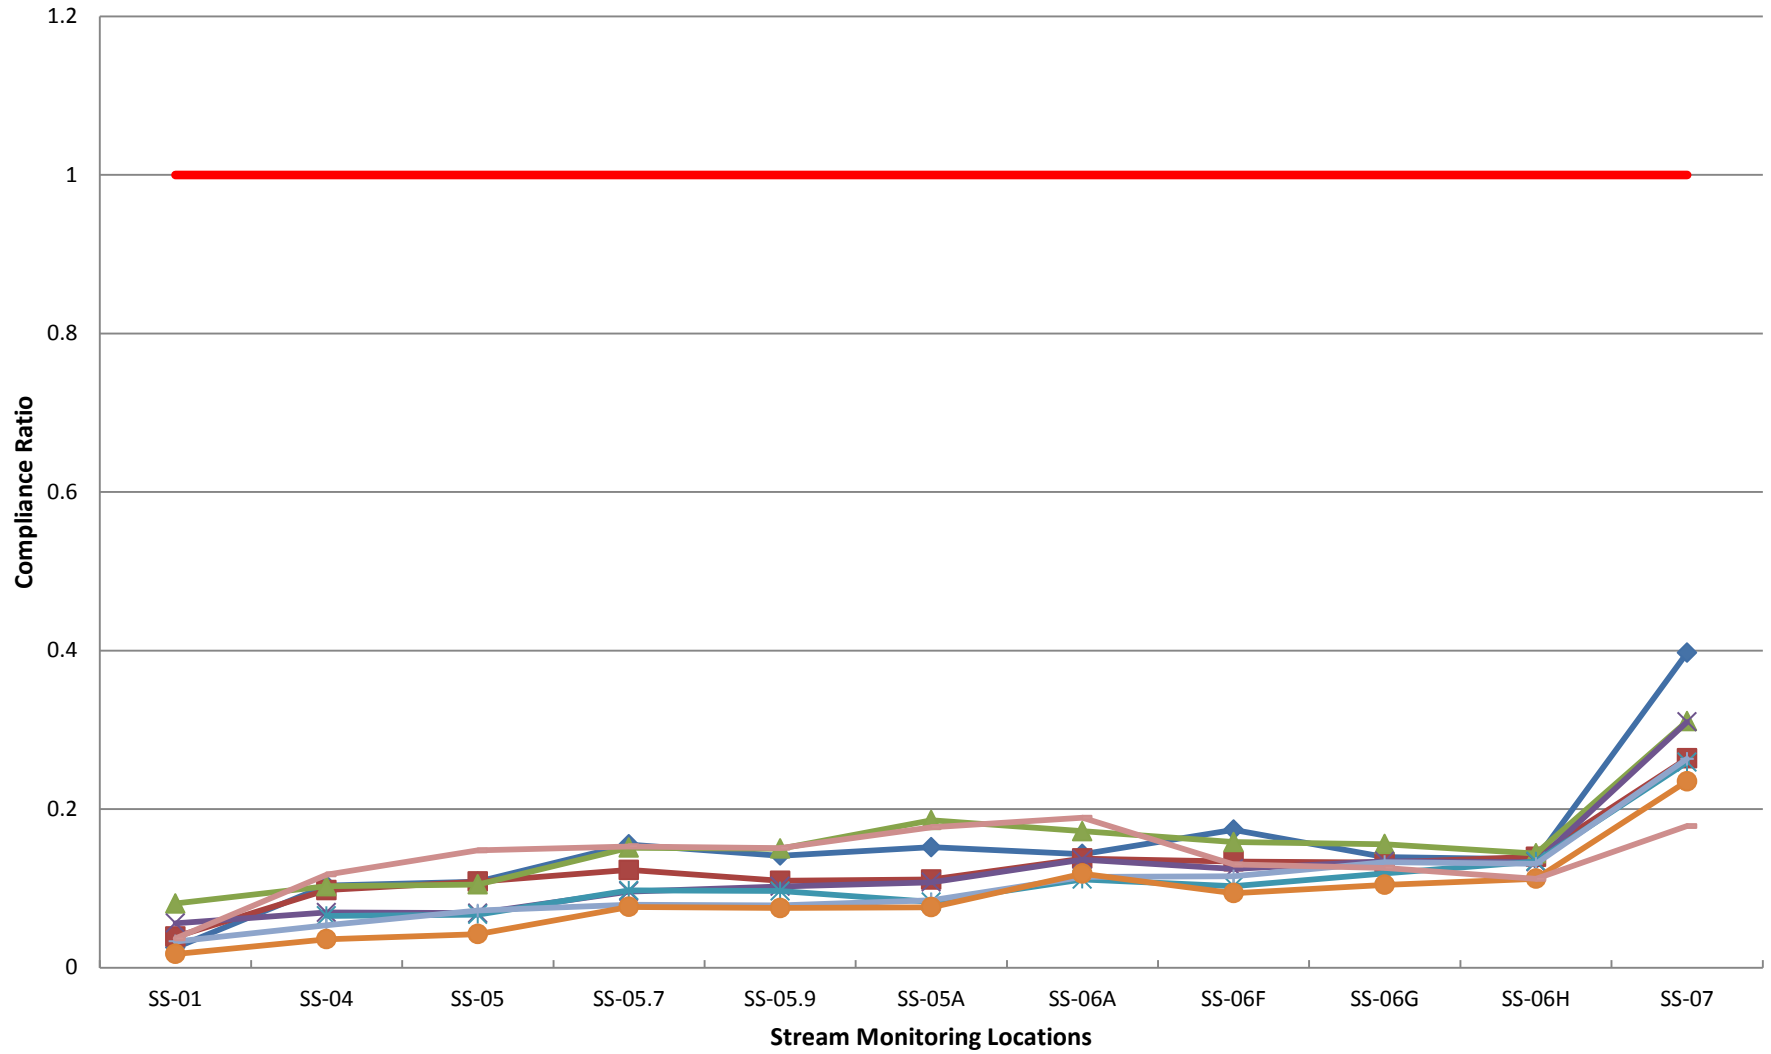

- Chronic Standard
- ▲ 6/28/2011 Elevated Flow
- ◆ 2/3/2011
- × 7/6/2011 Elevated Flow
- 4/6/2011 Slightly Elevated Flow
- ✱ 7/12/2011 Elevated Flow
- + 7/19/2011 Elevated Flow
- 9/7/2011
- 12/1/2011