



2013 Dissolved Arsenic Compliance Ratios (Base Flow)

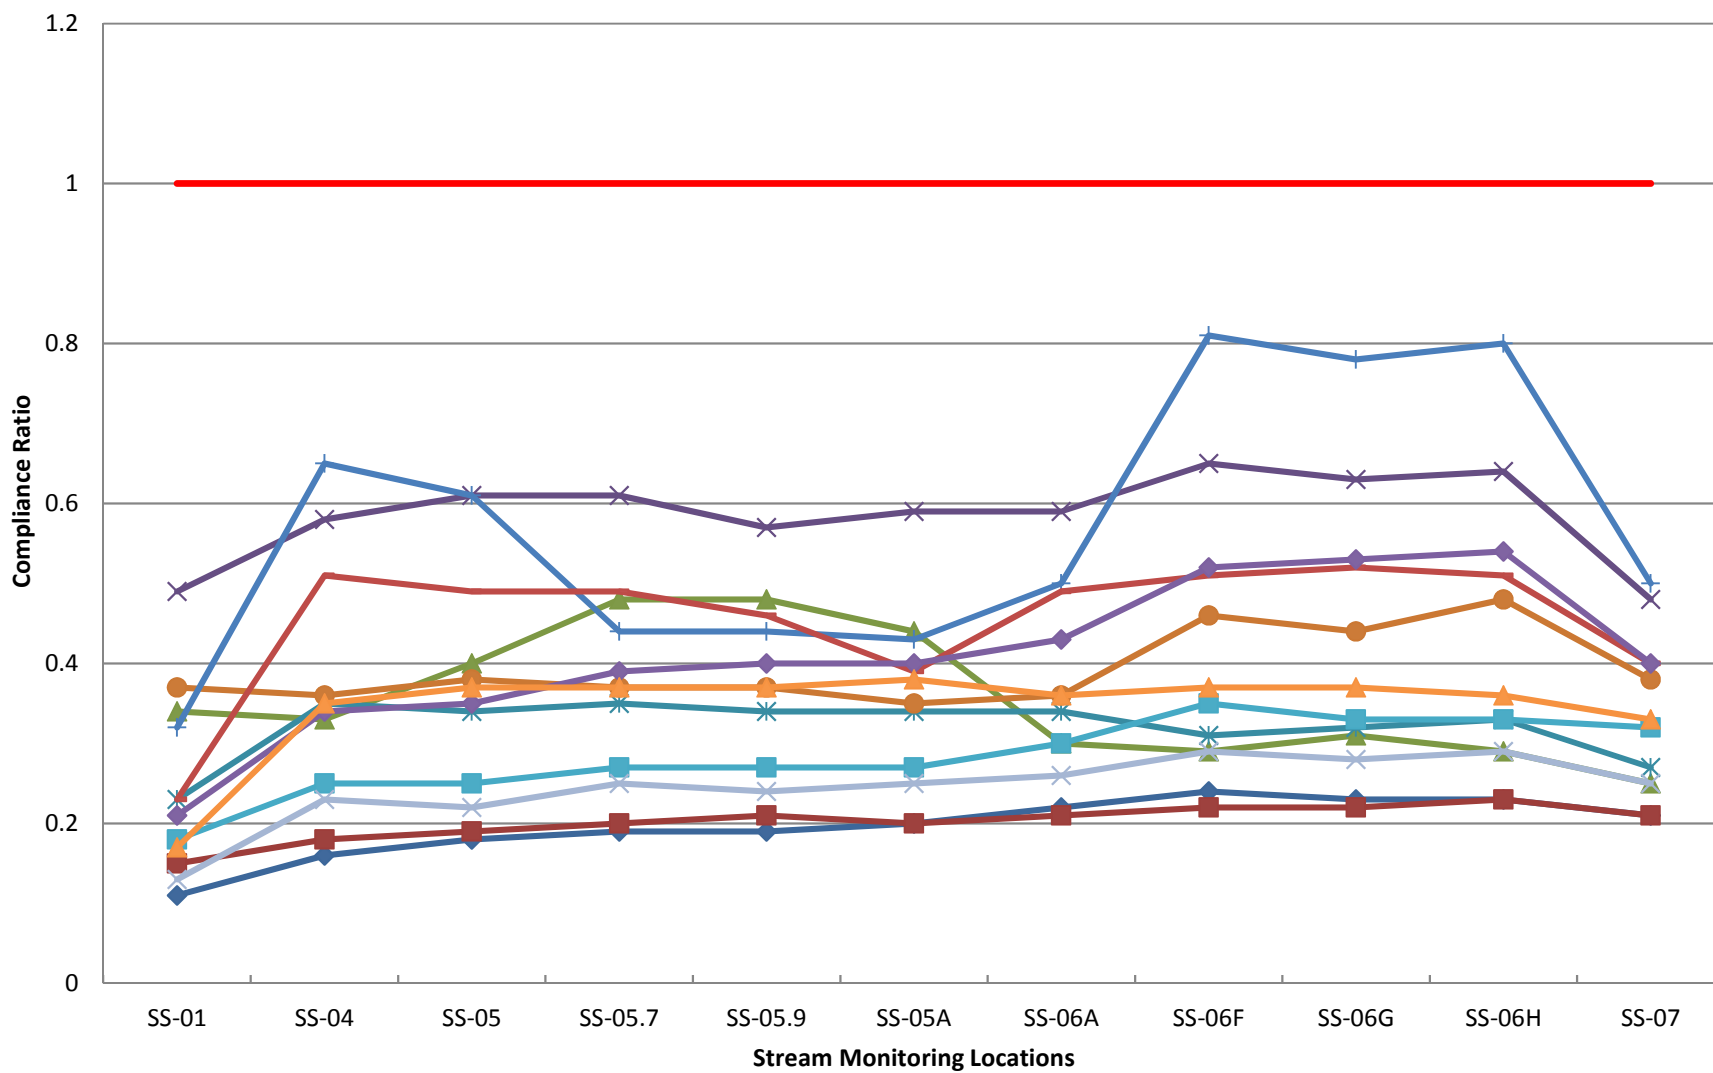


The Compliance Ratio is equal to the analyte concentration (value) divided by the constituents aquatic life standard (CR= Value/Standard). The standard is represented as a compliance ratio of one.

2013 Total Recoverable Arsenic Compliance Ratios (Base Flow)

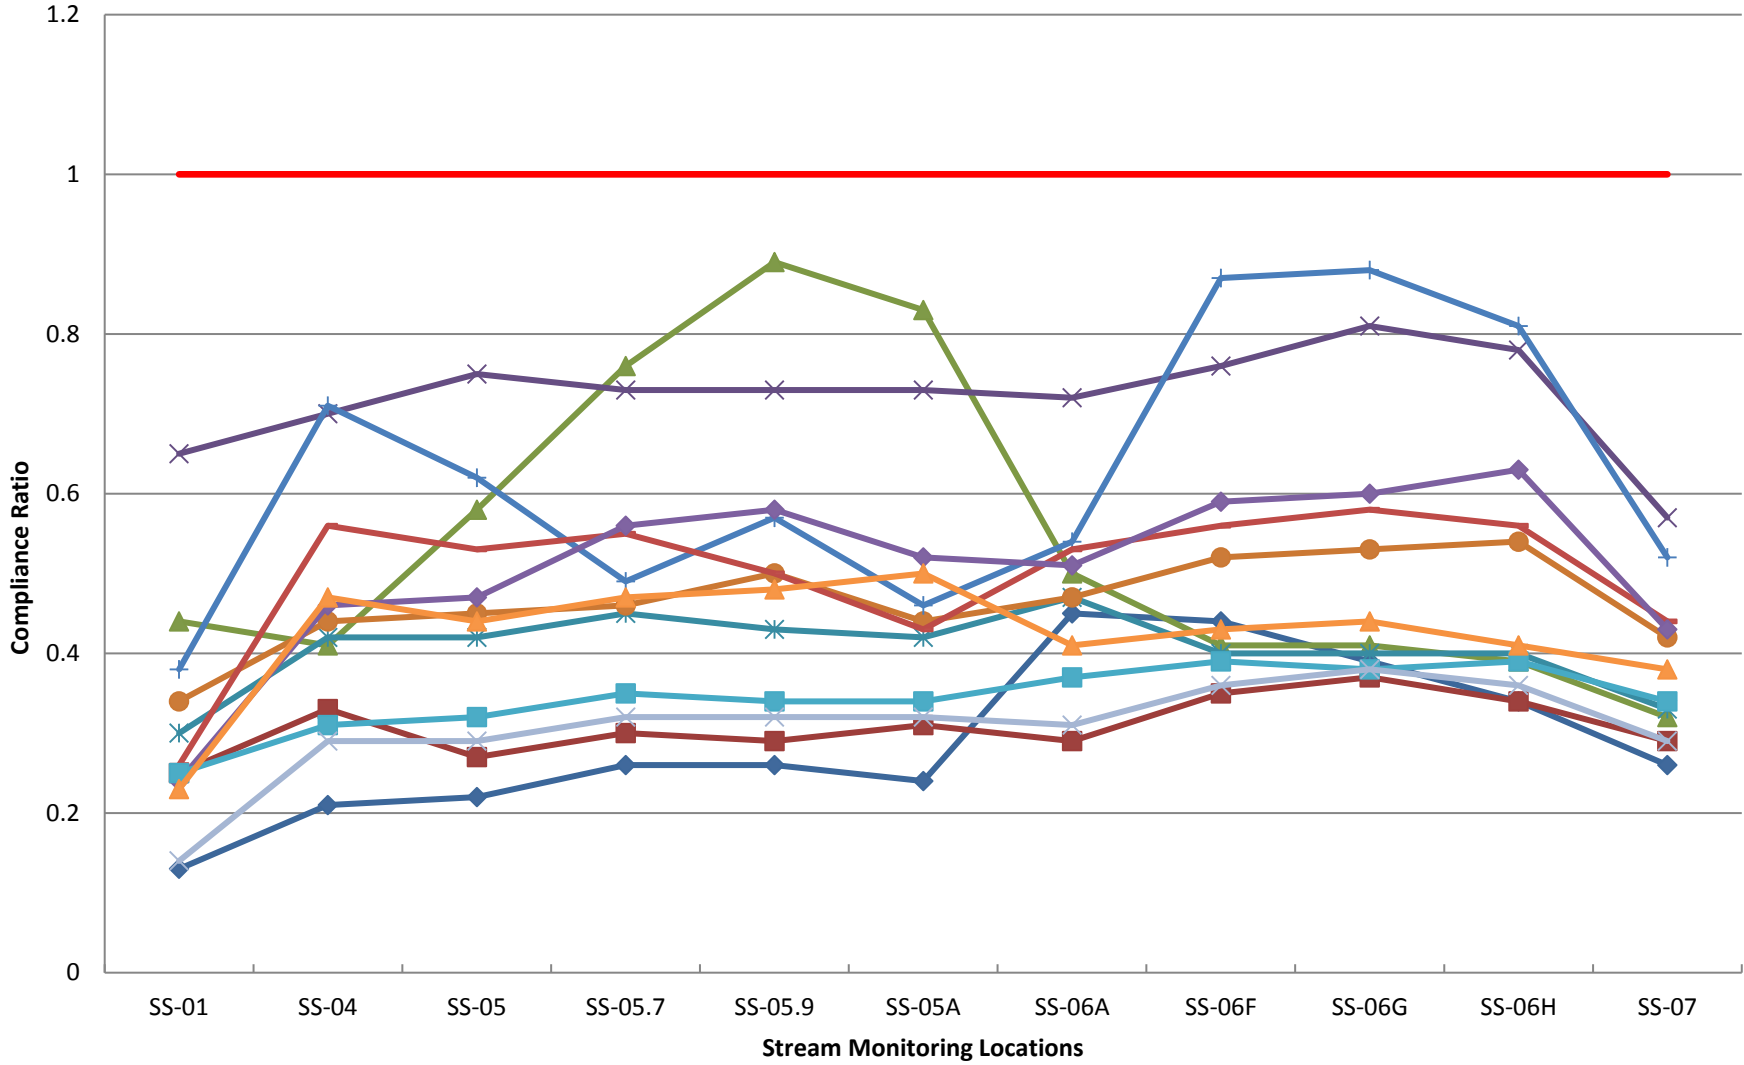


— HH Standard
 ◆ 1/22/2013
 ■ 2/7/2013
 ▲ 3/19/2013
 ✱ 4/12/2013
 ● 5/7/2013
 ✕ 6/18/2013
+ 7/10/2013
— 8/14/2013
◆ 9/11/2013
■ 10/17/2013
▲ 11/6/2013
✕ 12/17/2013

2013 Dissolved Cadmium Compliance Ratios (Base Flow)

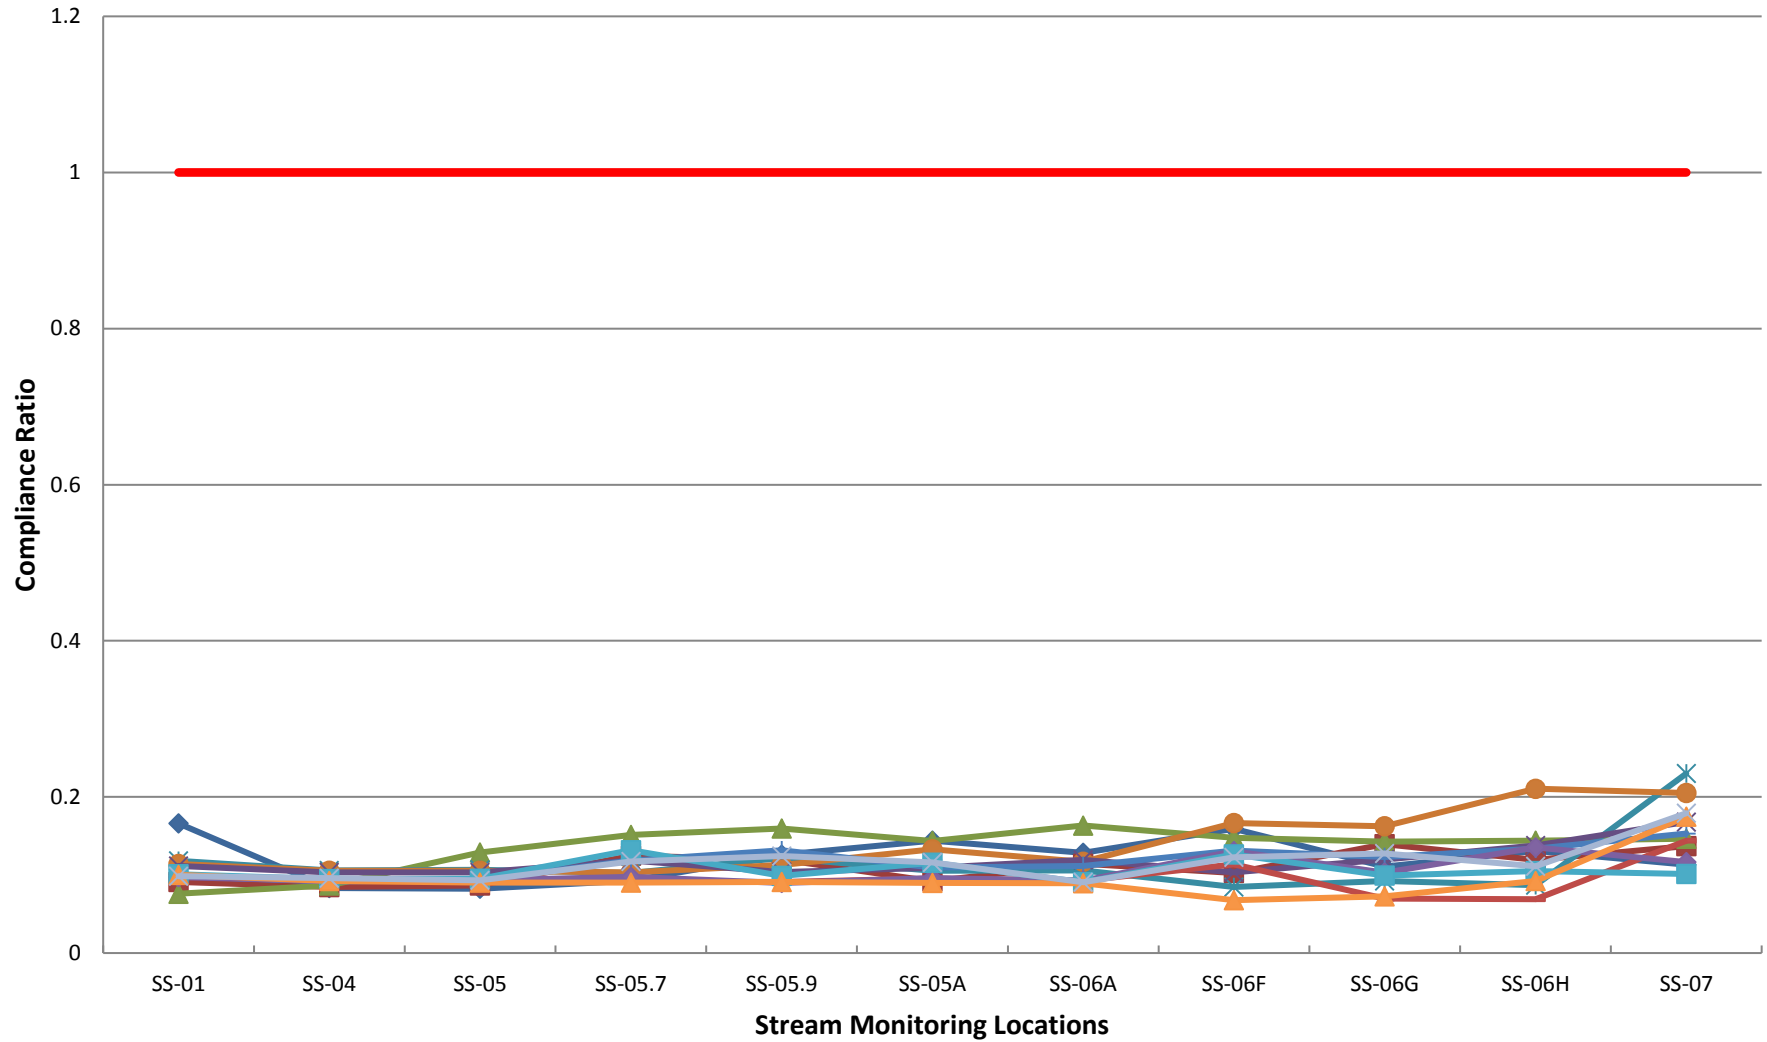


2013 Total Recoverable Cadmium Compliance Ratios (Base Flow)

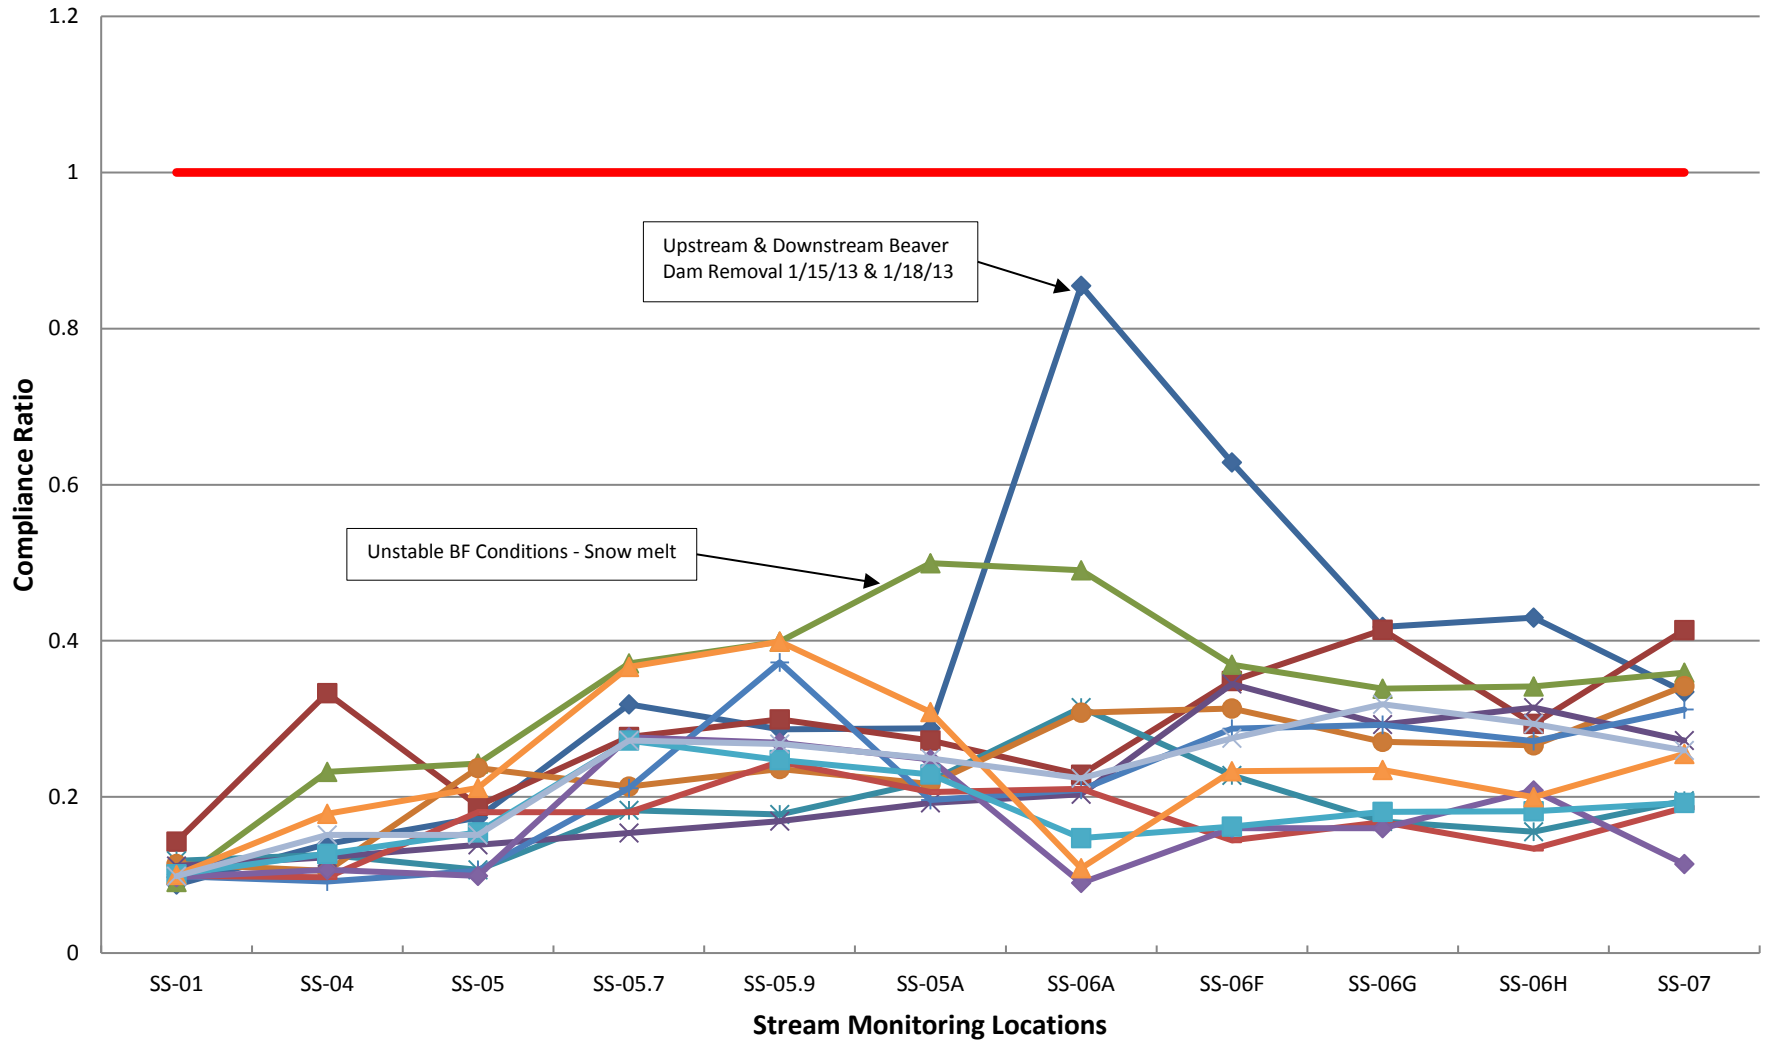


- | | | | | |
|---|---|---|--|---|
| — Chronic Standard | —◆— 1/22/2013 | —■— 2/7/2013 | —▲— 3/19/2013 | —✱— 4/12/2013 |
| —●— 5/7/2013 | —✕— 6/18/2013 | —+— 7/10/2013 | —■— 8/14/2013 | —◇— 9/11/2013 |
| —■— 10/17/2013 | —▲— 11/6/2013 | —✱— 12/17/2013 | | |

2013 Dissolved Copper Compliance Ratios (Base Flow)

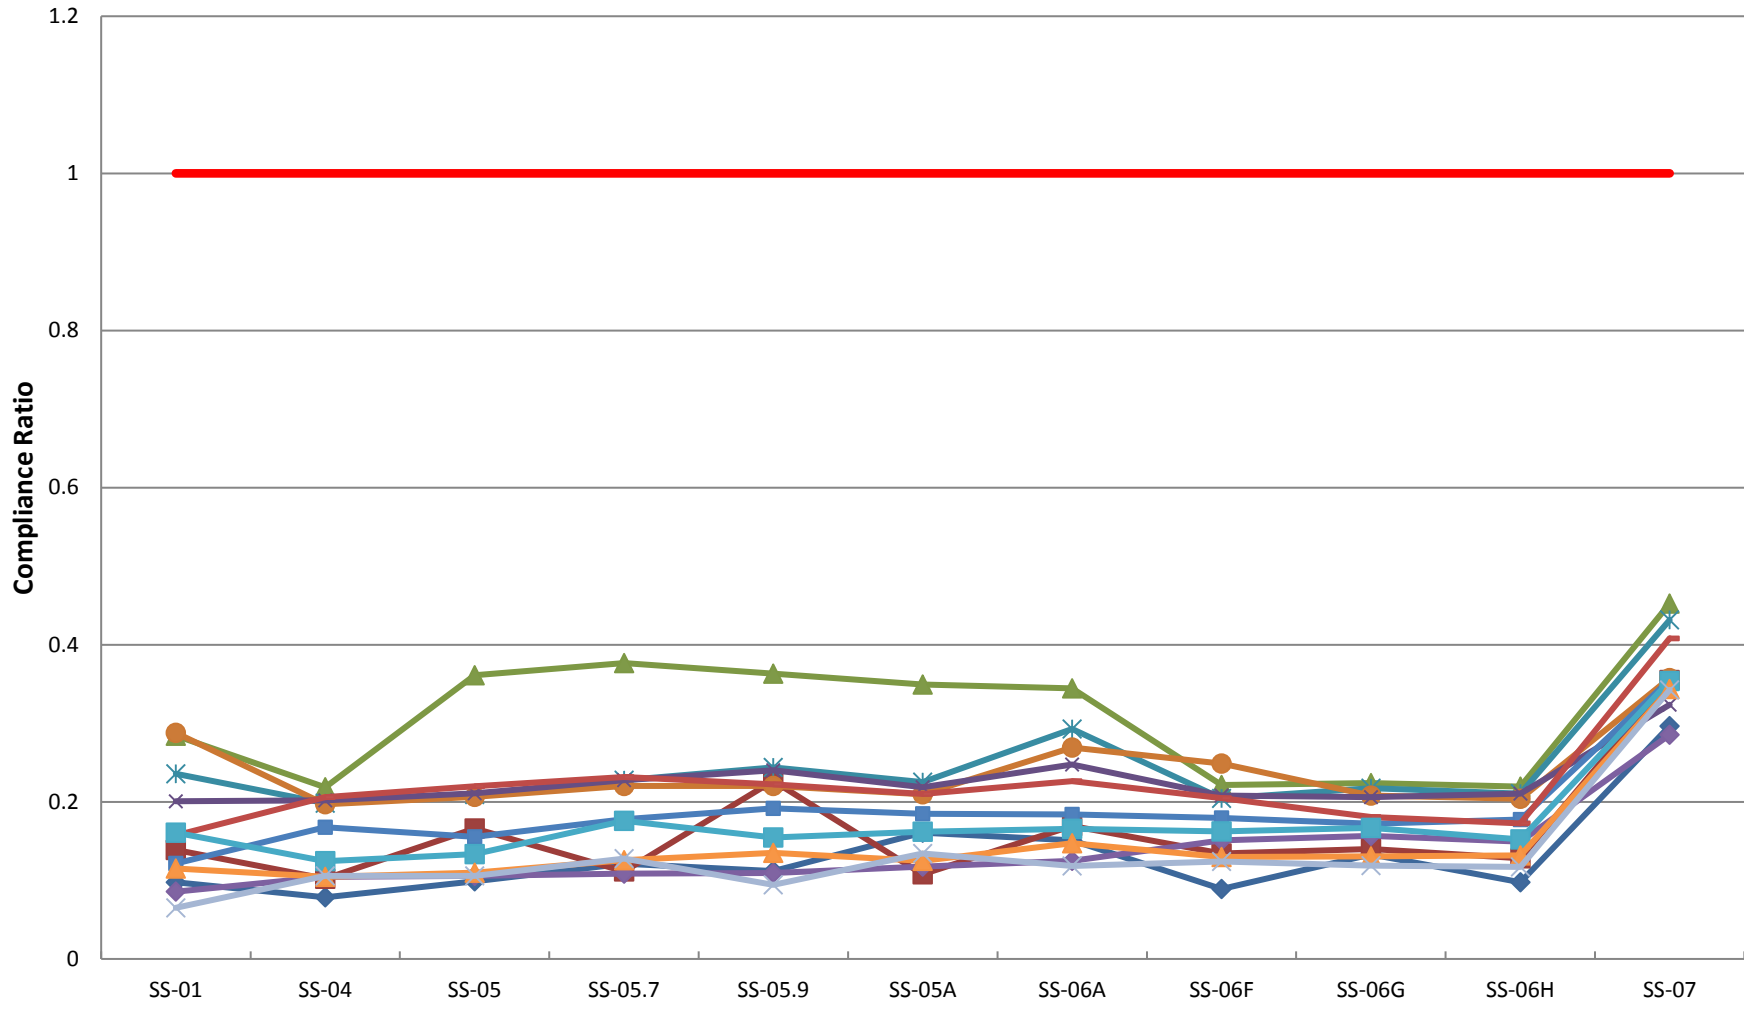


2013 Total Recoverable Copper Compliance Ratios (Base Flow)

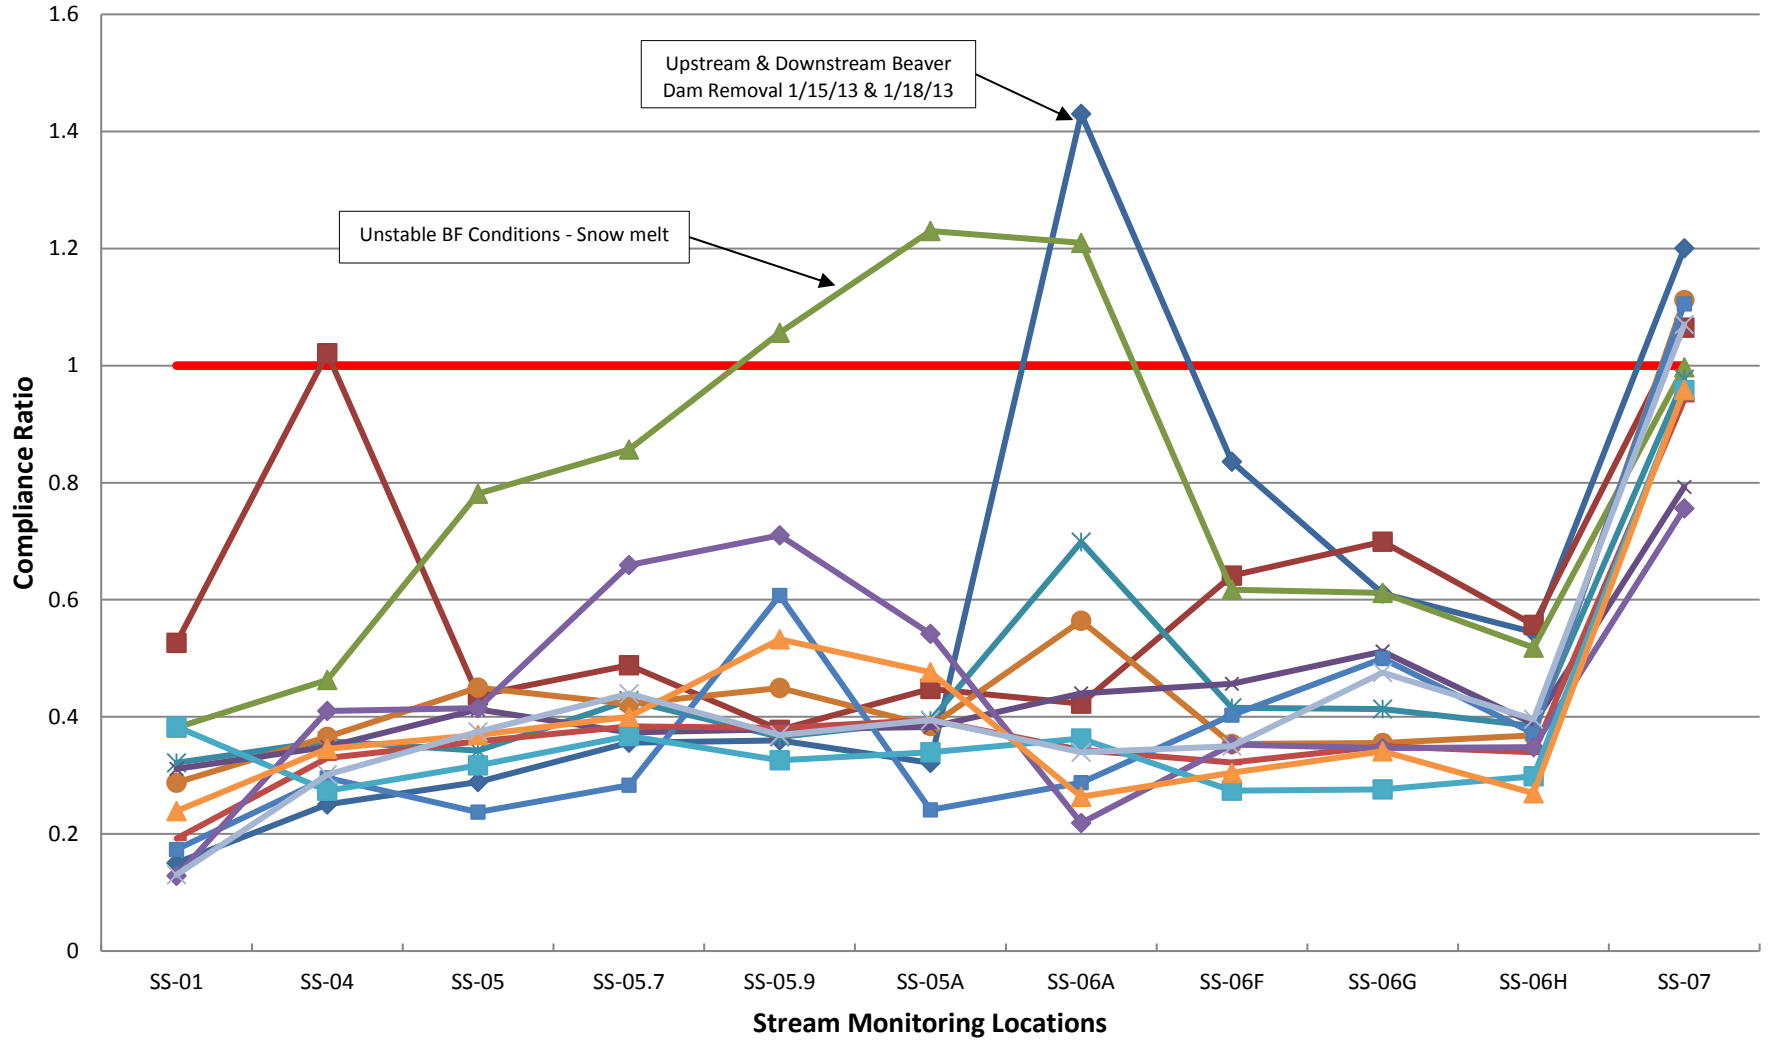


- | | | | | |
|---|---|---|--|---|
| — Chronic Standard | ◆ 1/22/2013 | ■ 2/7/2013 | ▲ 3/19/2013 | ✱ 4/12/2013 |
| ● 5/7/2013 | ✕ 6/18/2013 | ■ 7/10/2013 | ■ 8/14/2013 | ◆ 9/11/2013 |
| ■ 10/17/2013 | ▲ 11/6/2013 | ✕ 12/17/2013 | | |

2013 Dissolved Lead Compliance Ratios (Base Flow)

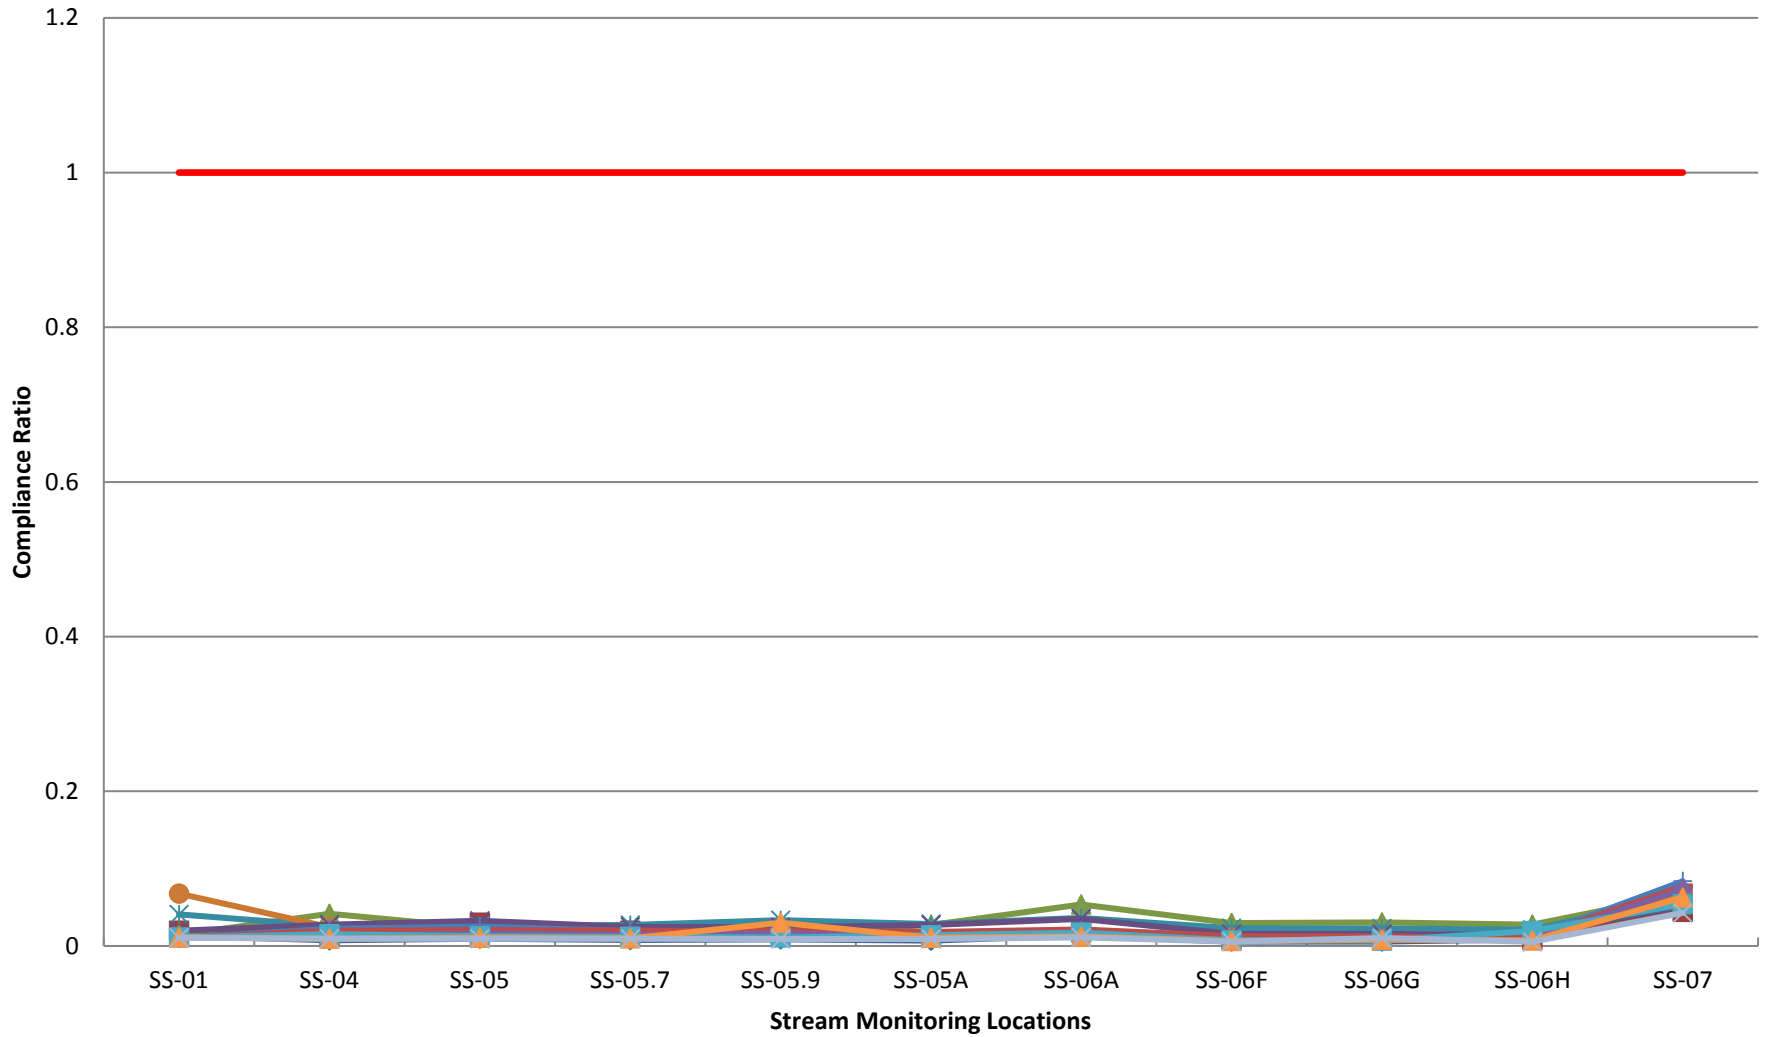


- Chronic Standard
 ◆ 1/22/2013
■ 2/7/2013
▲ 3/19/2013
✱ 4/12/2013
- 5/7/2013
 ✕ 6/18/2013
+ 7/10/2013
— 8/14/2013
◆ 9/11/2013
- 10/17/2013
 ▲ 11/6/2013
✕ 12/17/2013

2013 Total Recoverable Lead Compliance Ratios (Base Flow)

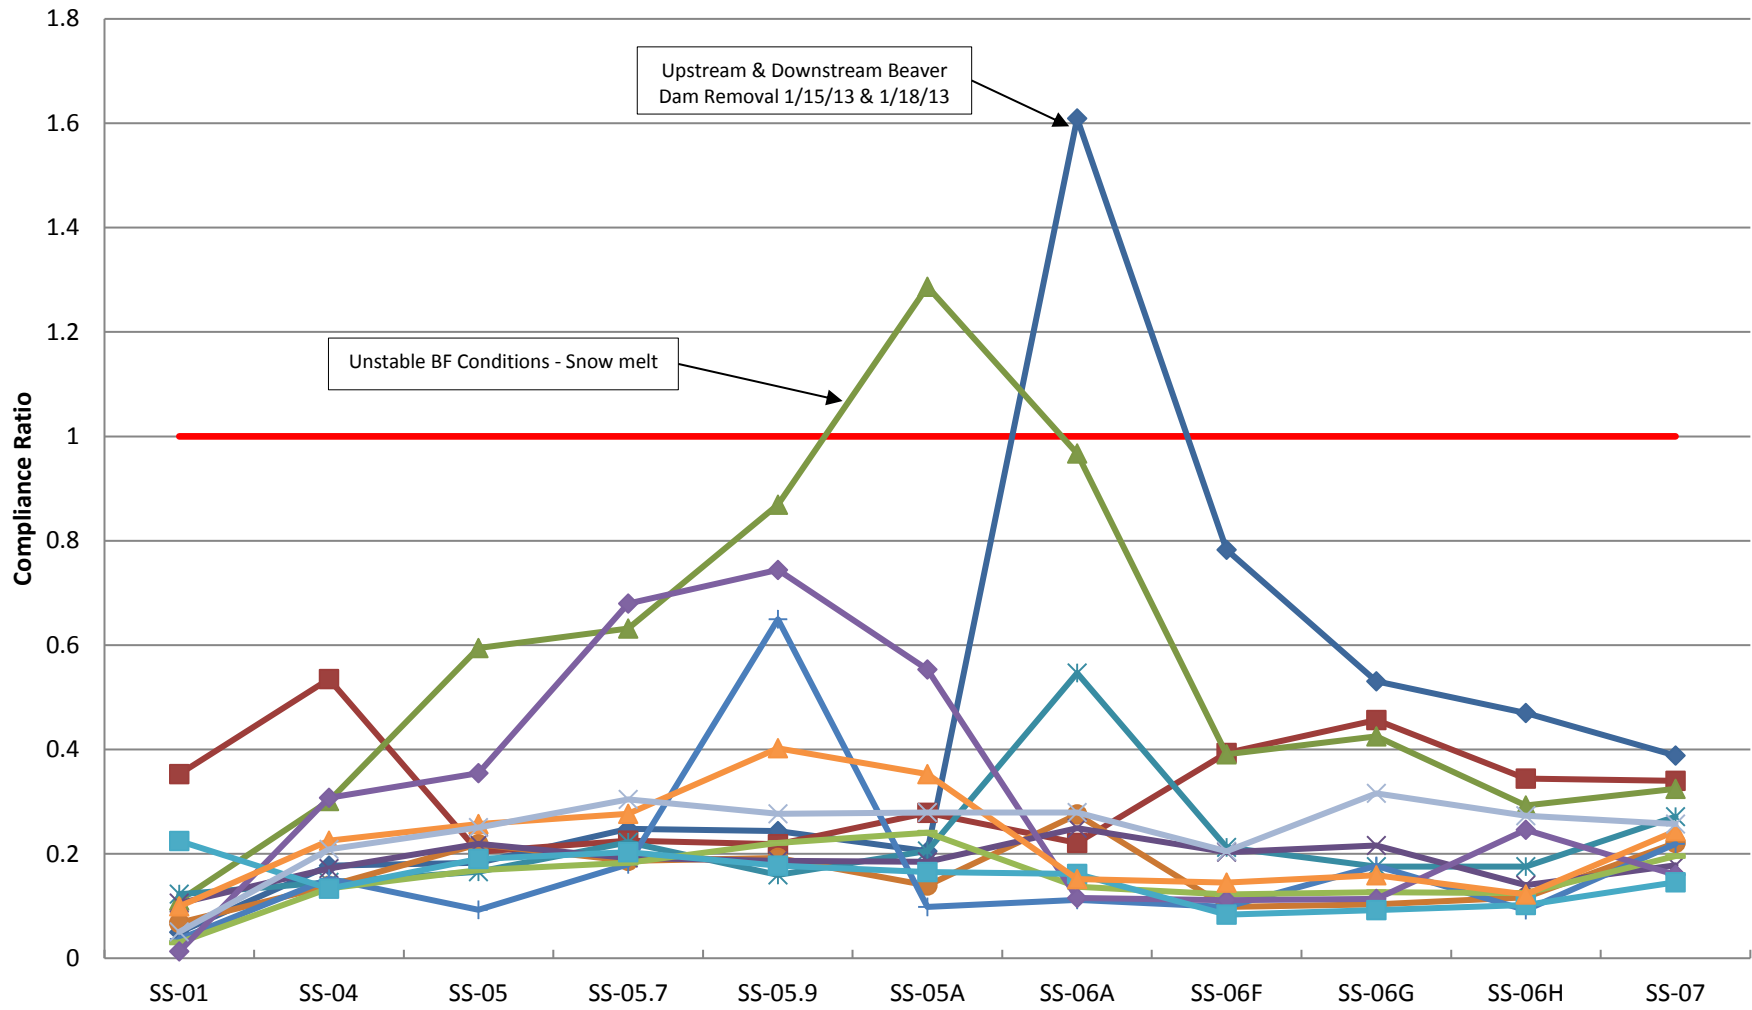


- | | | | | |
|---|---|---|---|---|
| — Chronic Standard | —◆— 1/22/2013 | —■— 2/7/2013 | —▲— 3/19/2013 | —✱— 4/12/2013 |
| —●— 5/7/2013 | —✕— 6/18/2013 | —+— 7/10/2013 | —■— 8/14/2013 | —◆— 9/11/2013 |
| —■— 10/17/2013 | —▲— 11/6/2013 | —✕— 12/17/2013 | | |

2013 Dissolved Zinc Compliance Ratios (Base Flow)

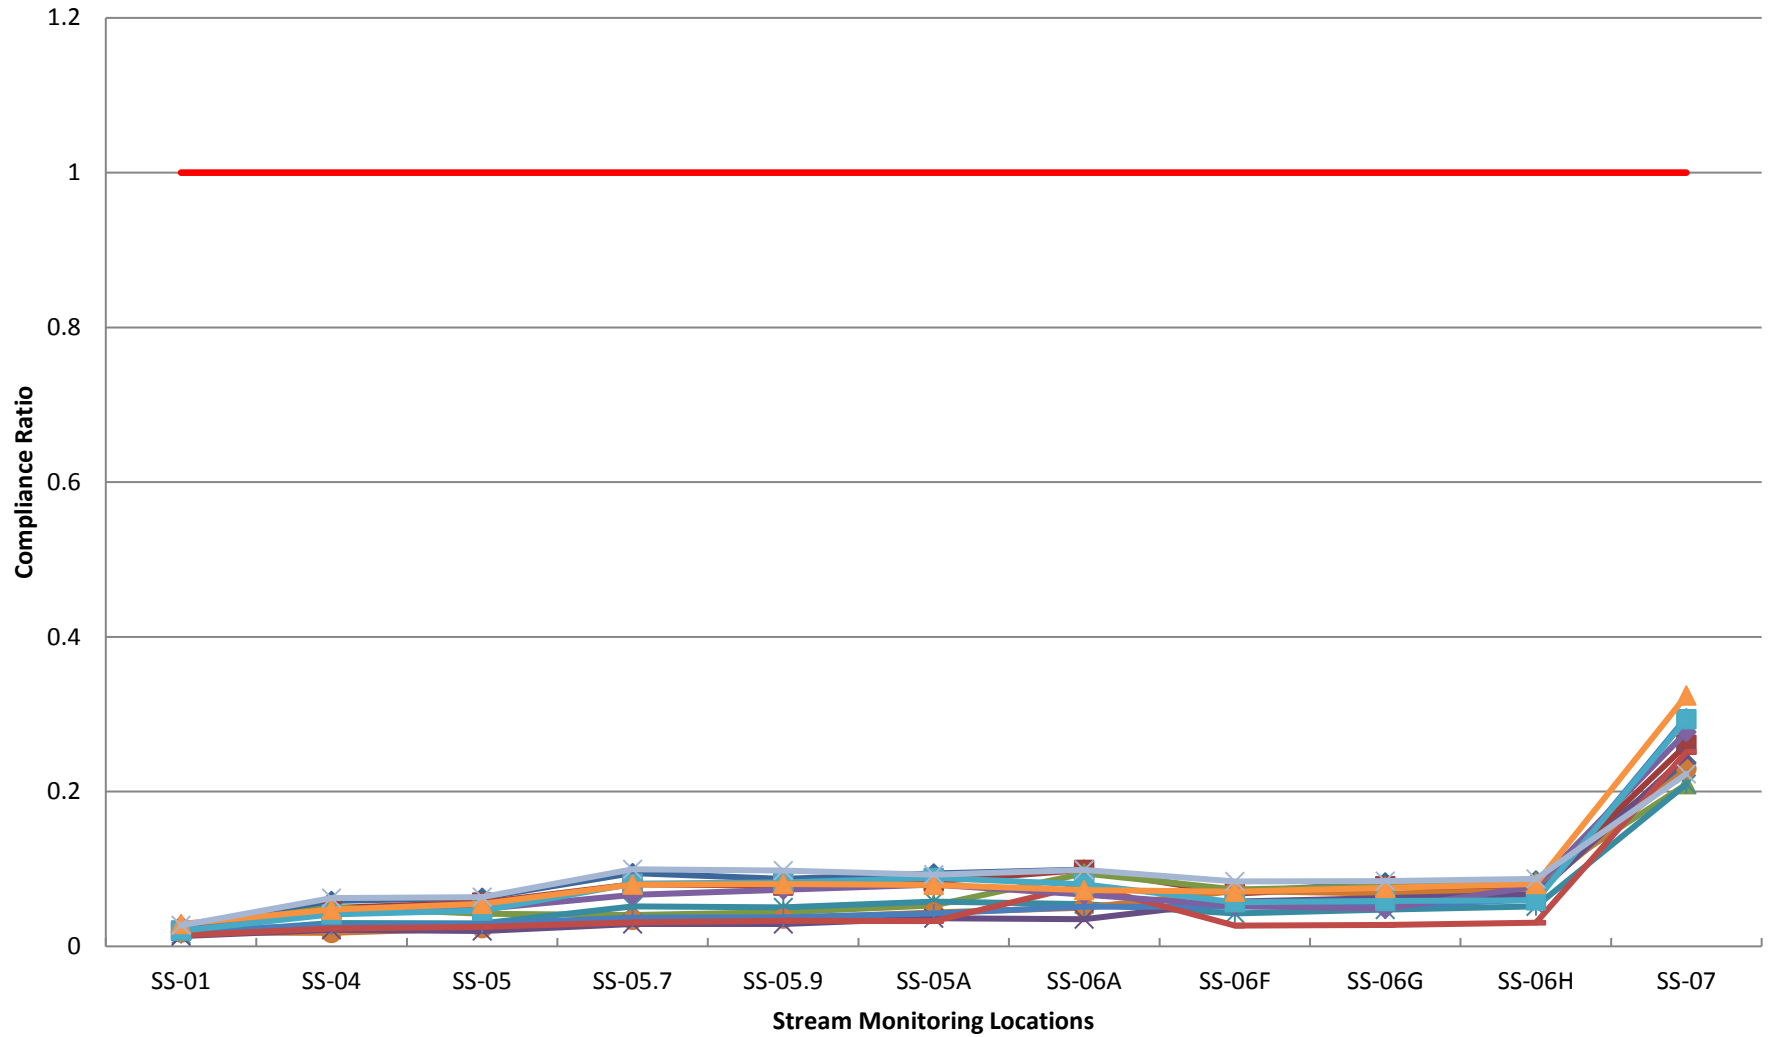

- | | | | |
|--------------------|-------------|--------------|-------------|
| — Chronic Standard | ◆ 1/22/2013 | ■ 2/7/2013 | ▲ 3/19/2013 |
| ● 5/7/2013 | × 6/18/2013 | + 7/10/2013 | * 4/12/2013 |
| ■ 10/17/2013 | ▲ 11/6/2013 | × 12/17/2013 | |

2013 Total Recoverable Zinc Compliance Ratios (Base Flow)

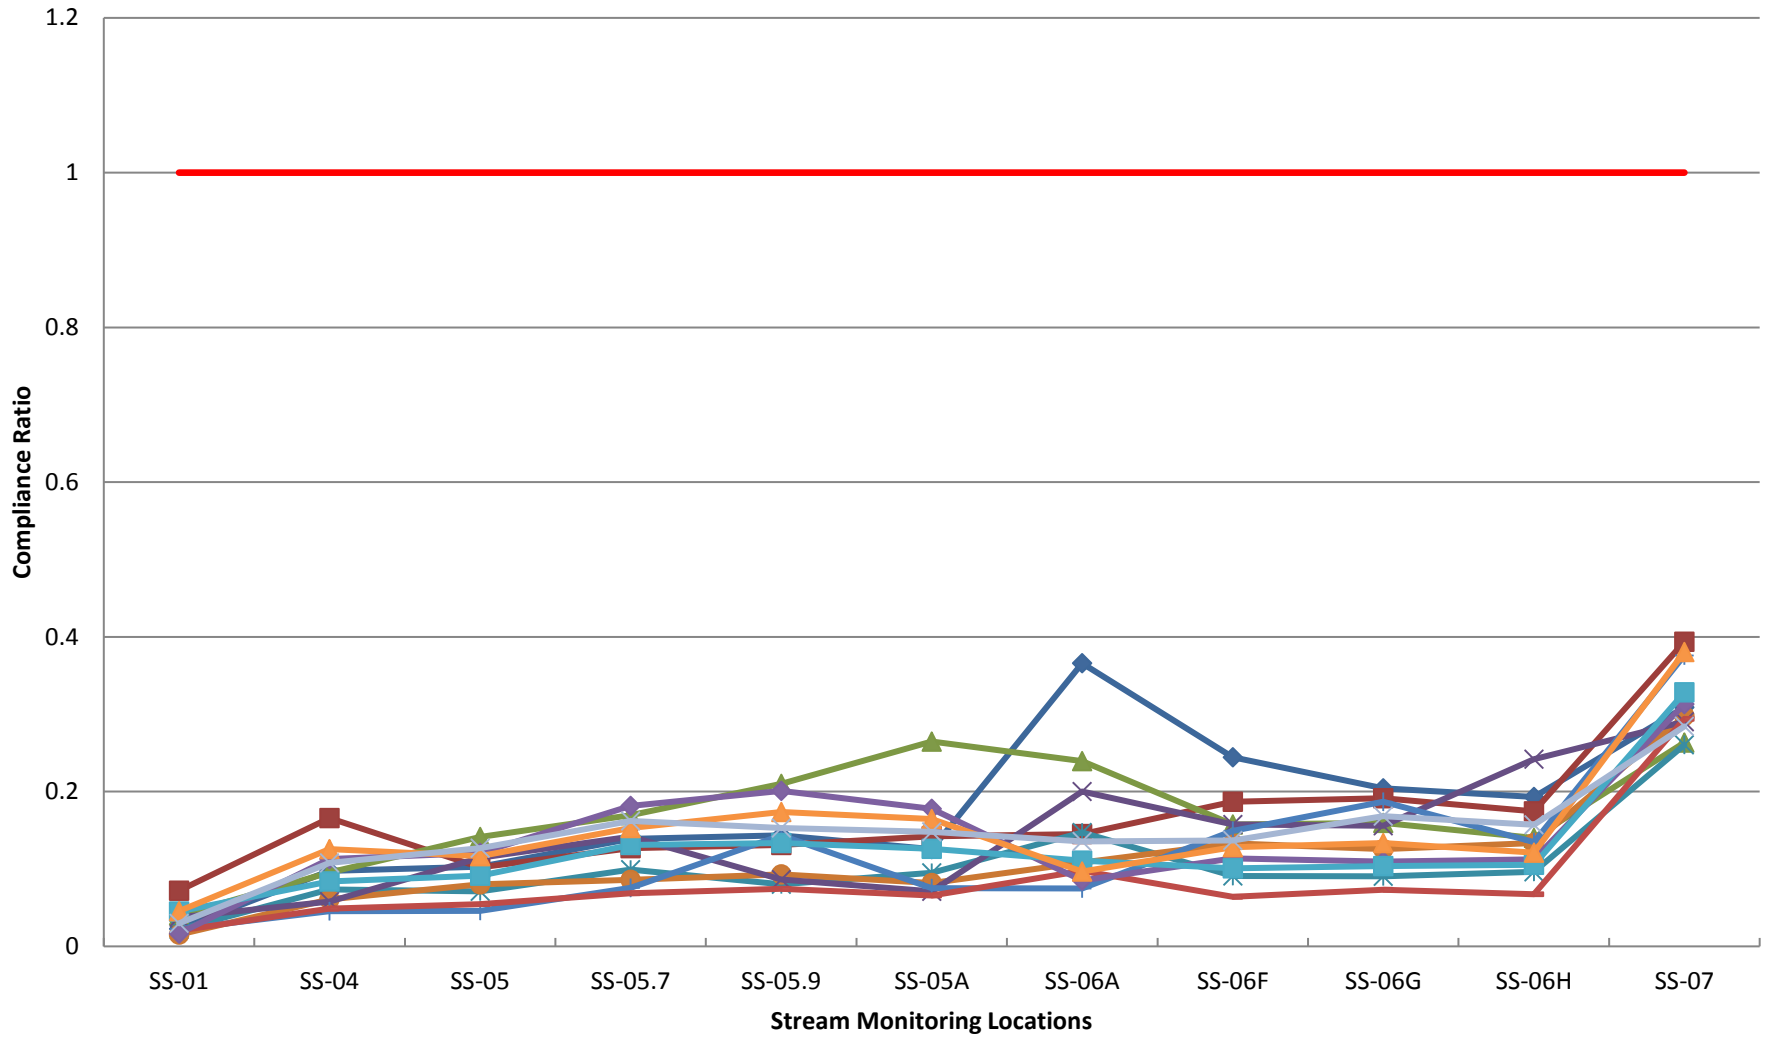

- | | | | | |
|---|---|---|--|---|
| — Chronic Standard | —◆— 1/22/2013 | —■— 2/7/2013 | —▲— 3/19/2013 | —✱— 4/12/2013 |
| —●— 5/7/2013 | —✕— 6/18/2013 | —+— 7/10/2013 | —■— 8/14/2013 | —◆— 9/11/2013 |
| —■— 10/17/2013 | —▲— 11/6/2013 | —✕— 12/17/2013 | | |