


# Butte Treatment Lagoon System Arsenic Concentration




Arsenic maximum standards are WQB-7 Human Health and Chronic Aquatic Surface Water standards.  
IDL: 0.0005 mg/L

# Butte Treatment Lagoon System Cadmium Concentration

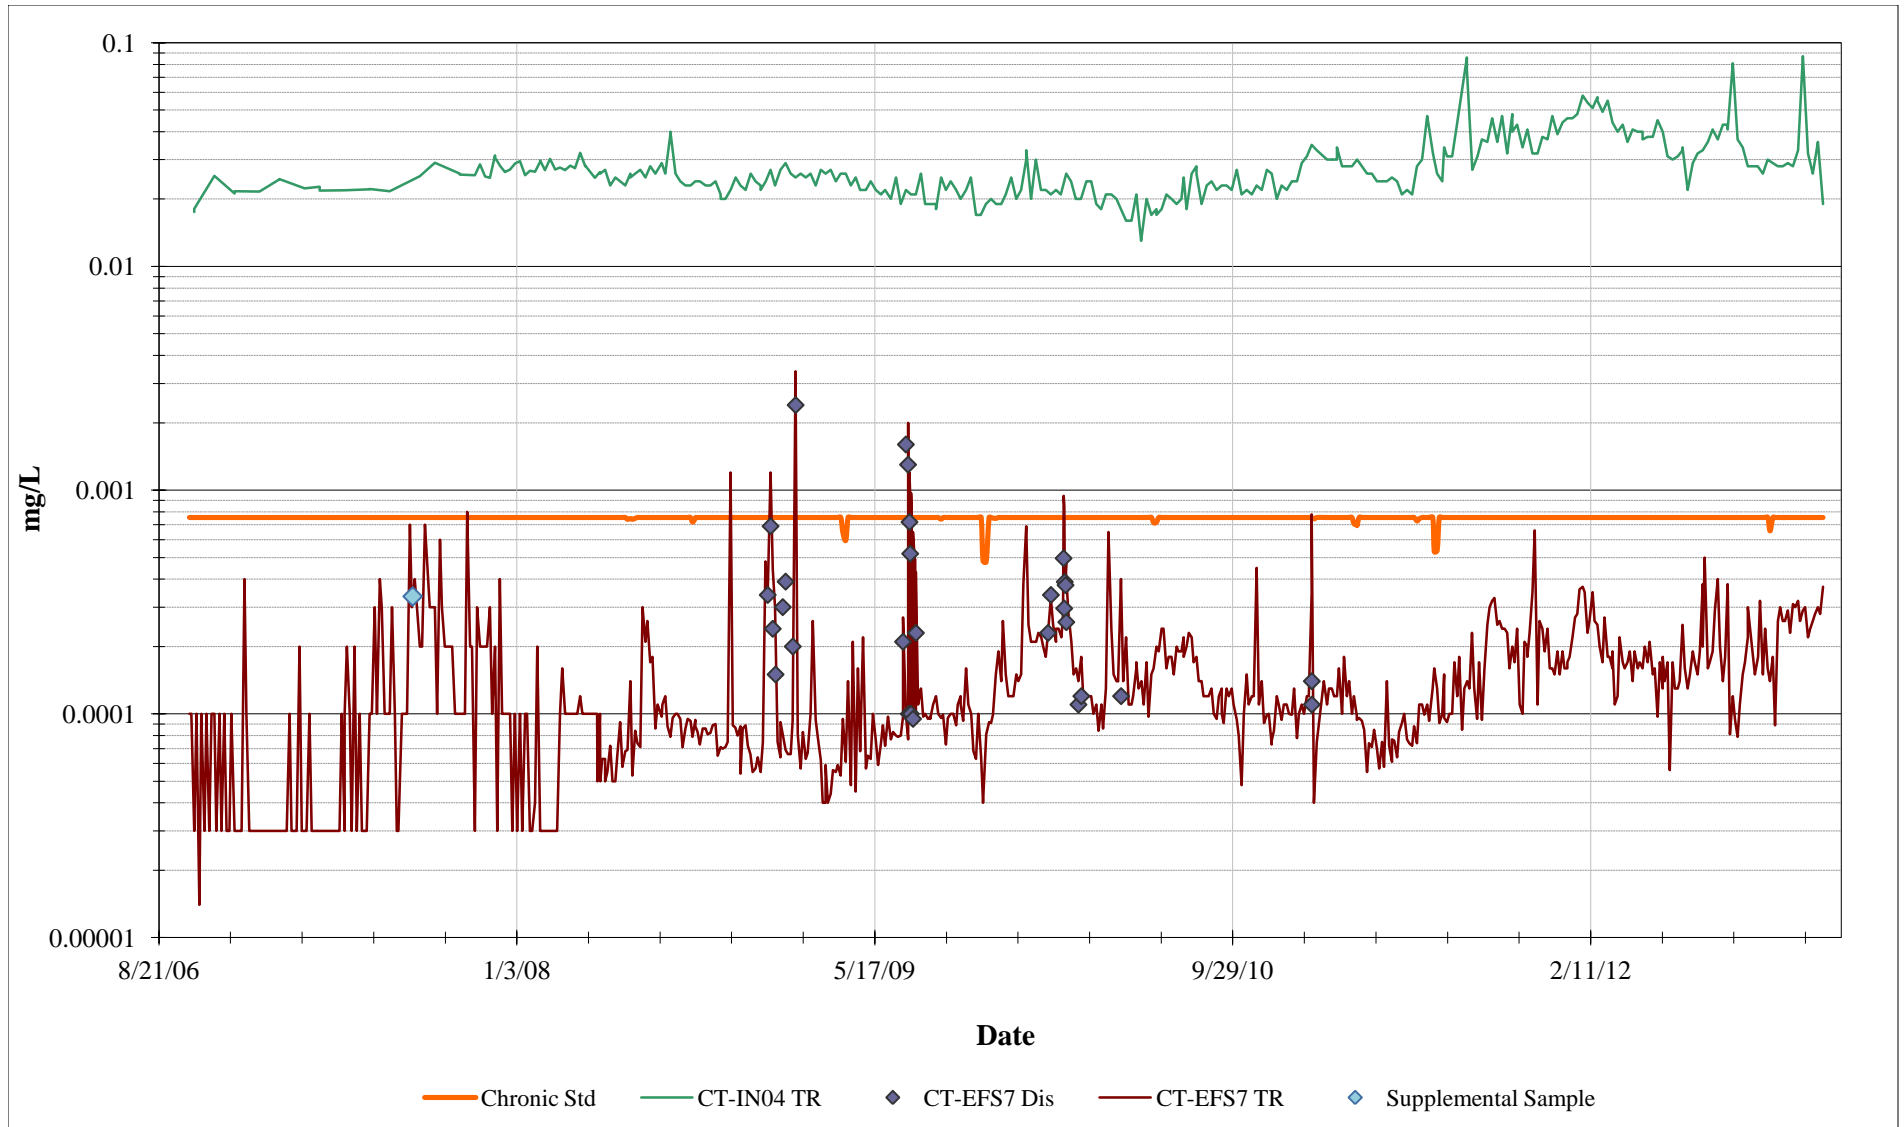


Cadmium maximum standards (WQB-7 Aquatic Life standards) are calculated from effluent (CT-EFS7) hardness.  
IDL: 0.00003 mg/L

# Butte Treatment Lagoon System Copper Concentration

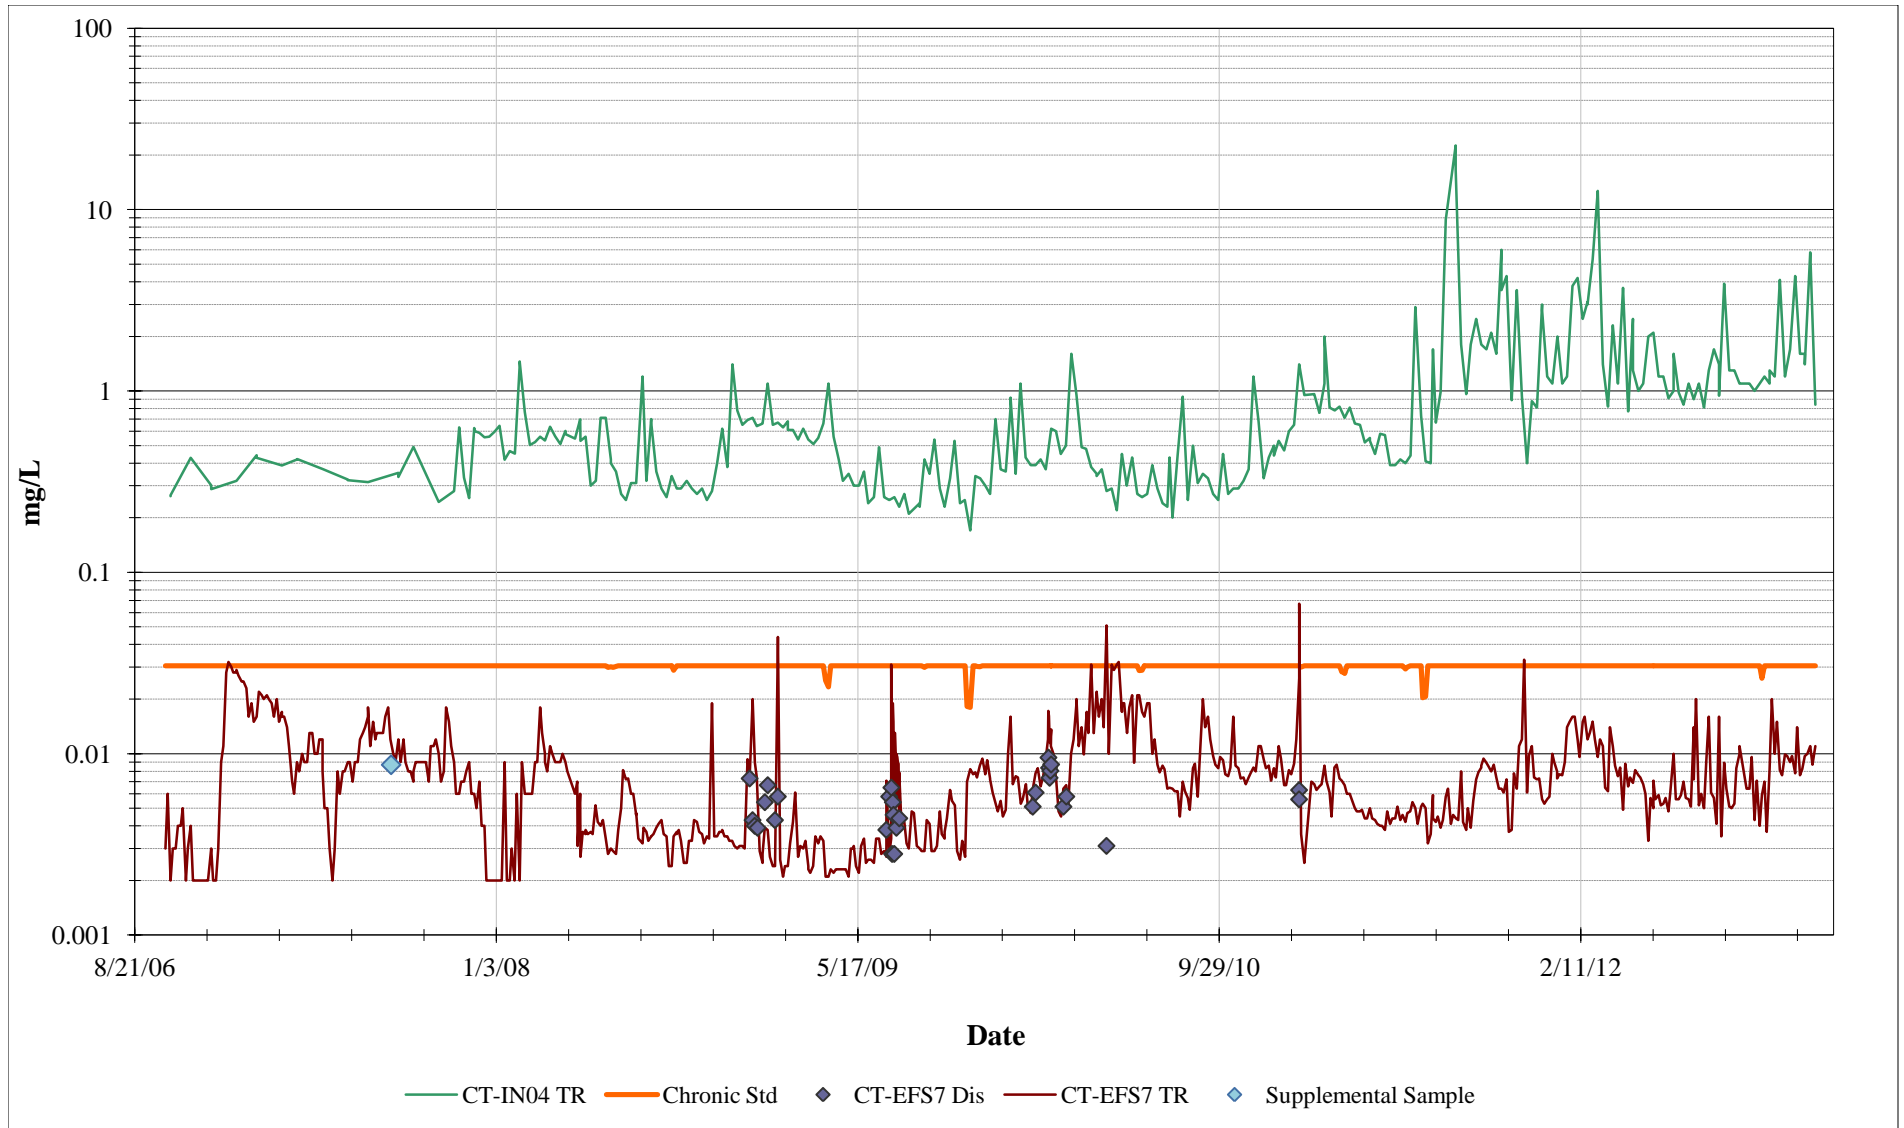


Copper maximum standards (WQB-7 Aquatic Life standards) are calculated from effluent (CT-EFS7) hardness.  
IDL: 0.002 mg/L


# Butte Treatment Lagoon System Lead Concentration

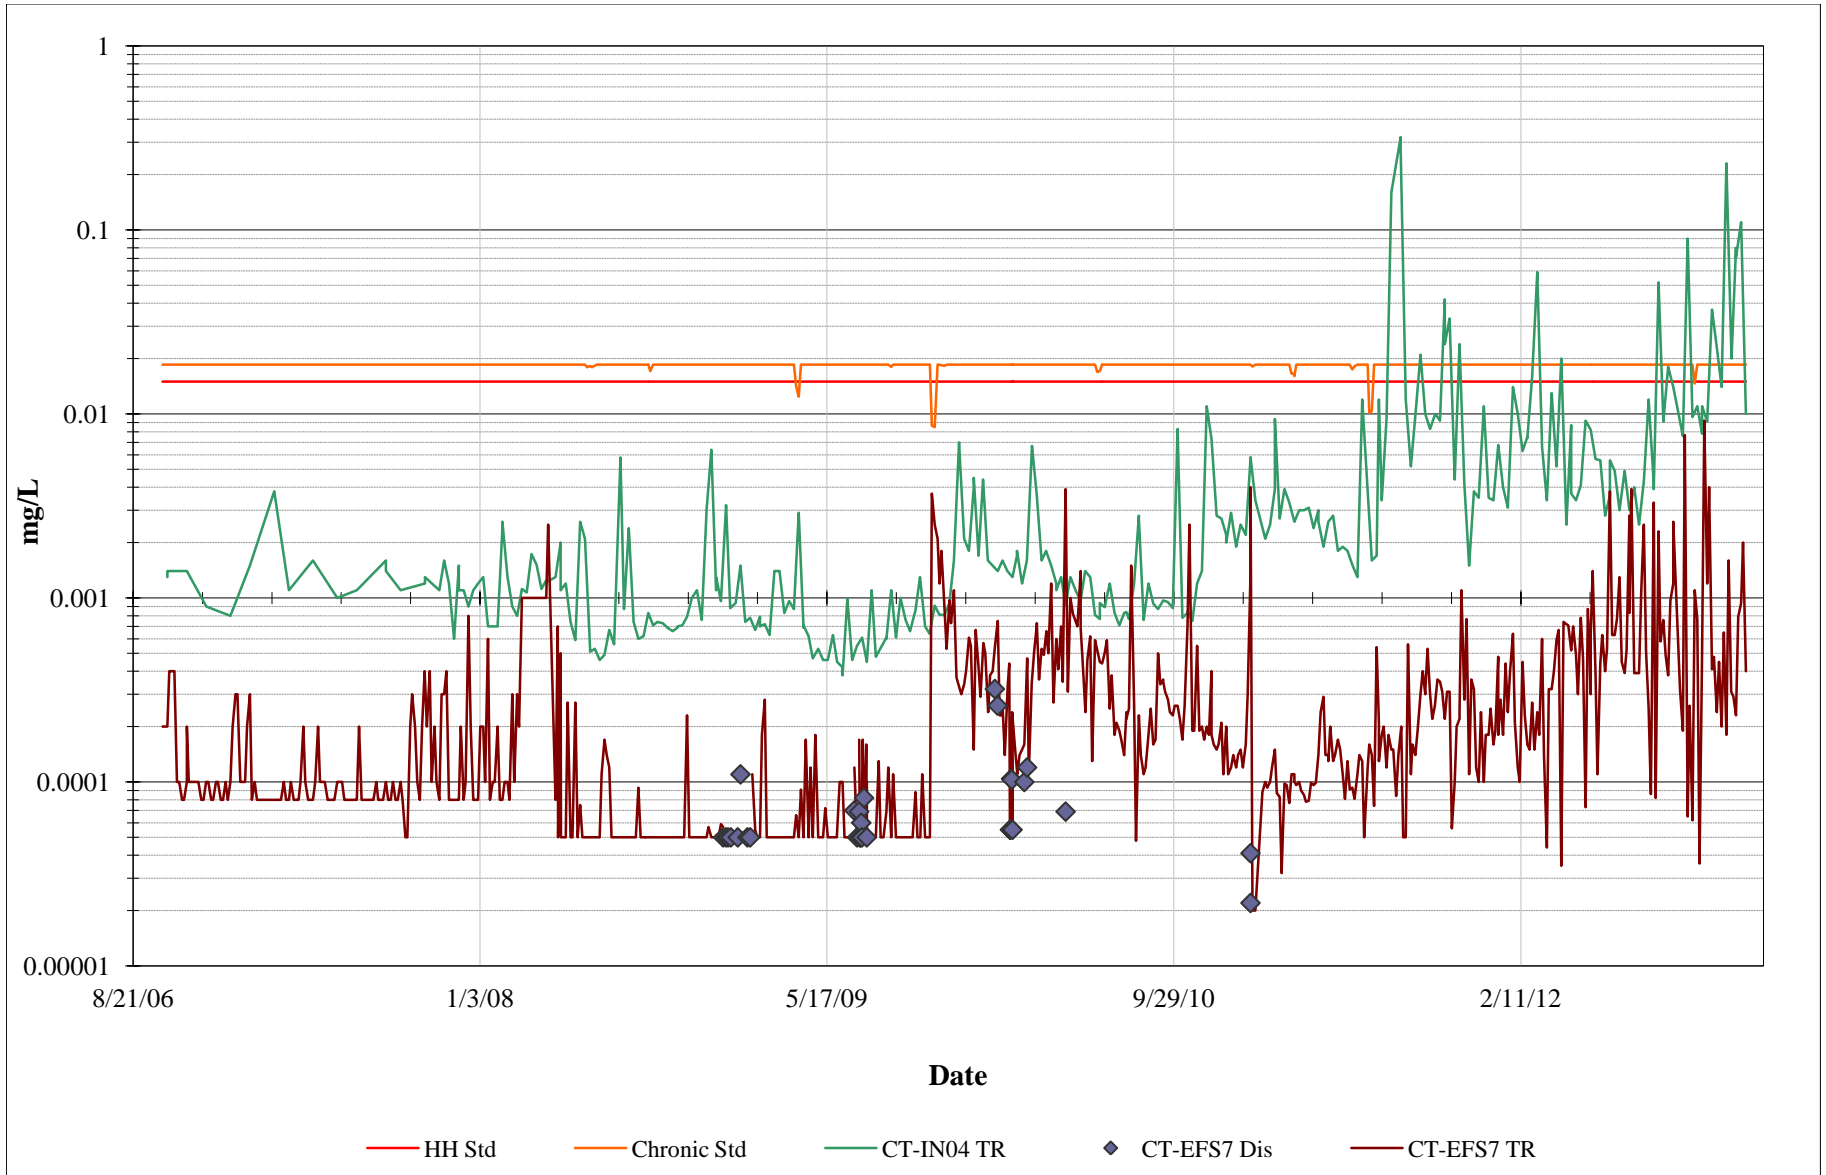

# Butte Treatment Lagoon System Mercury Concentration

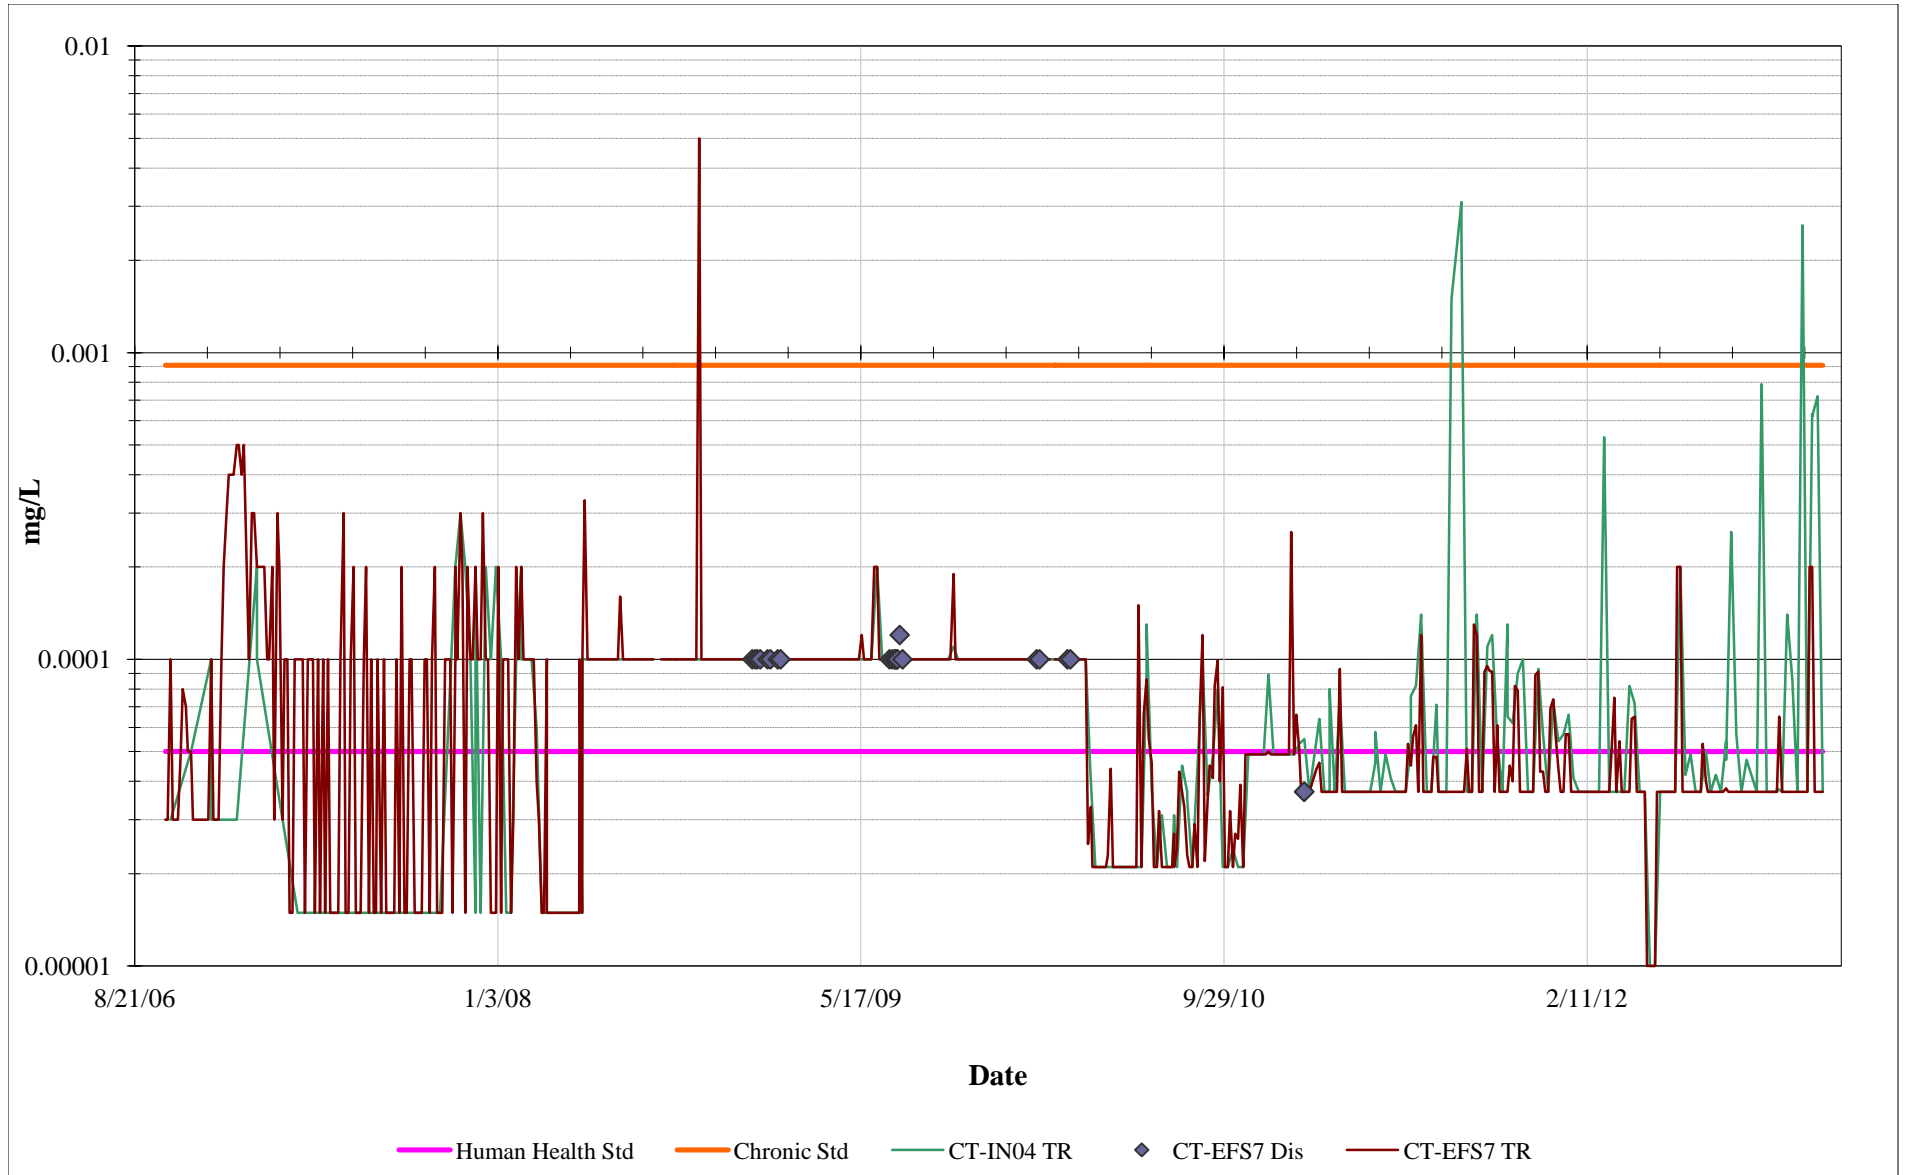

# Butte Treatment Lagoon System Zinc Concentration

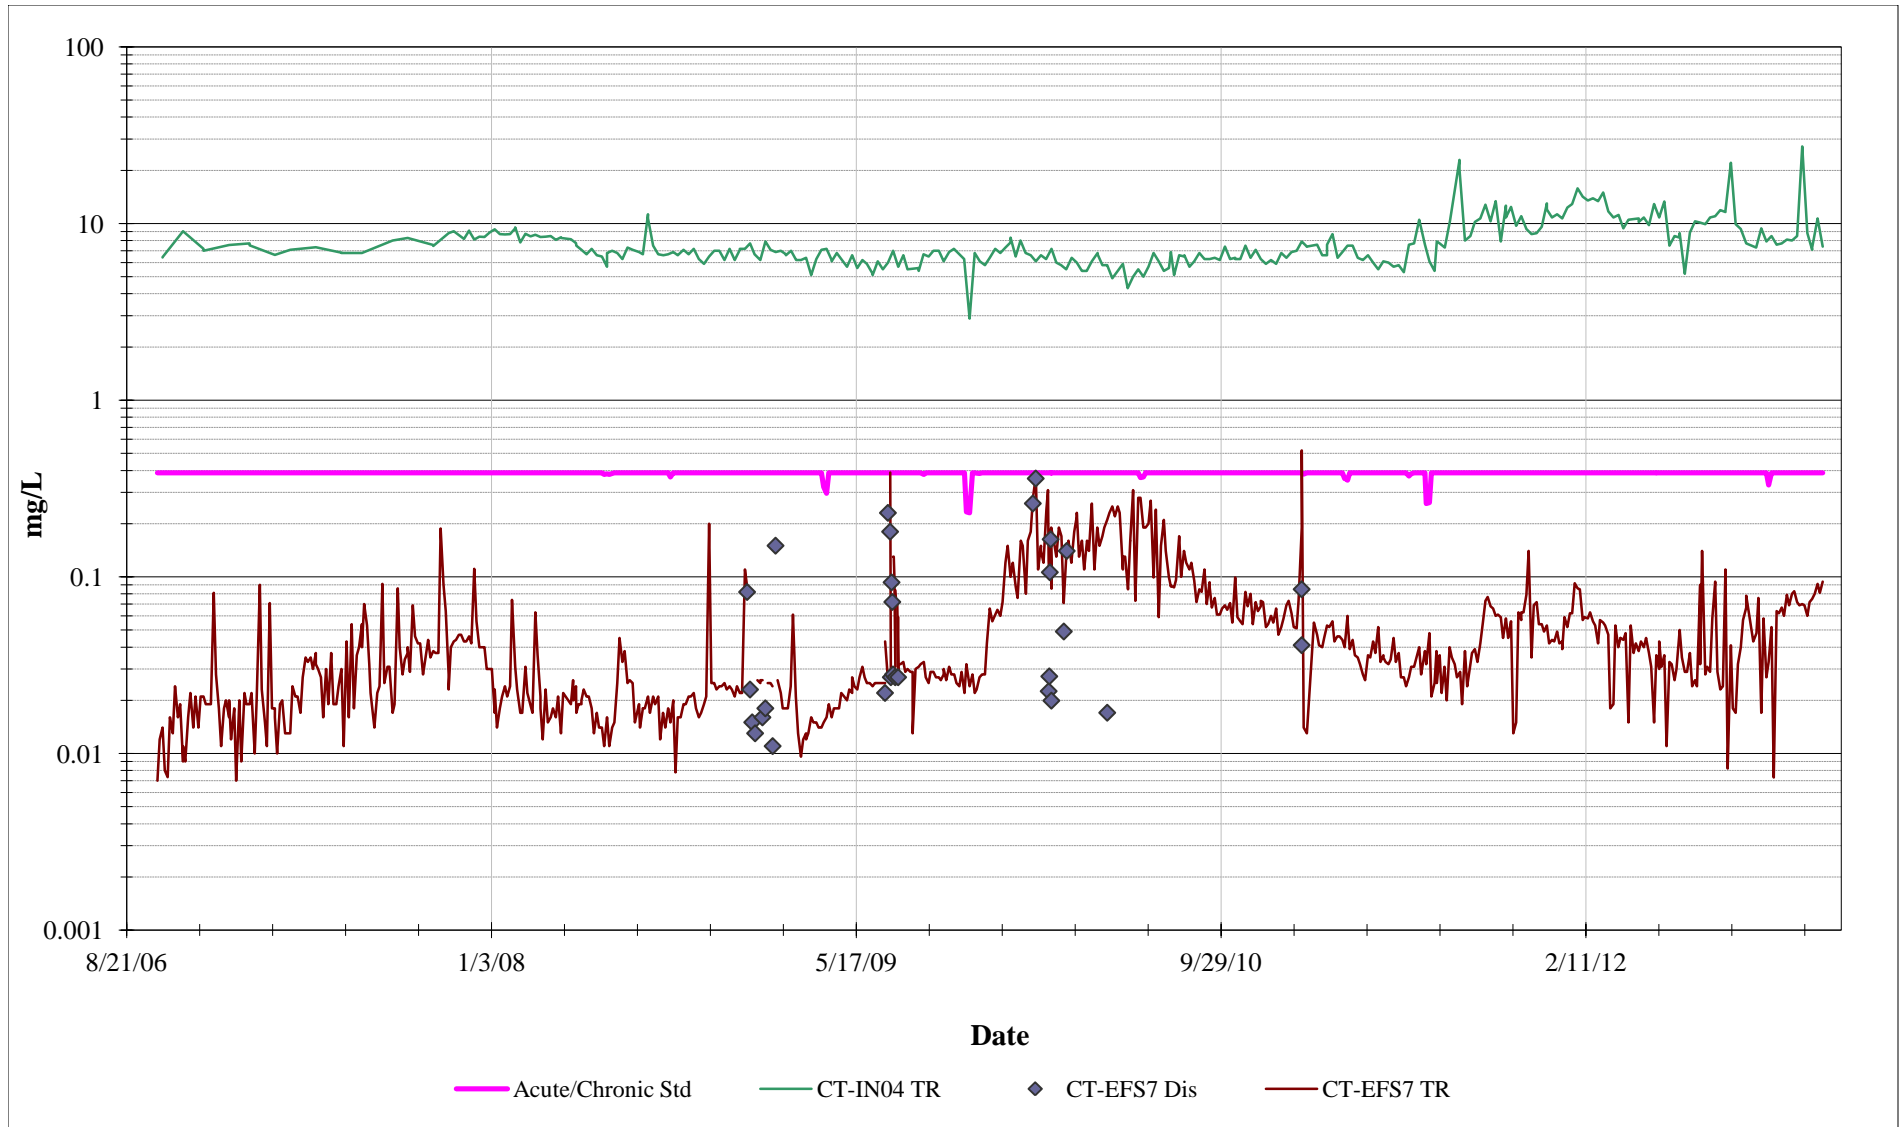

Zinc maximum standard (WQB-7 aquatic life standard) calculated from effluent (CT-EFS7) hardness.  
IDL: 0.007 mg/L