



# Butte Treatment Lagoon System Arsenic Concentration

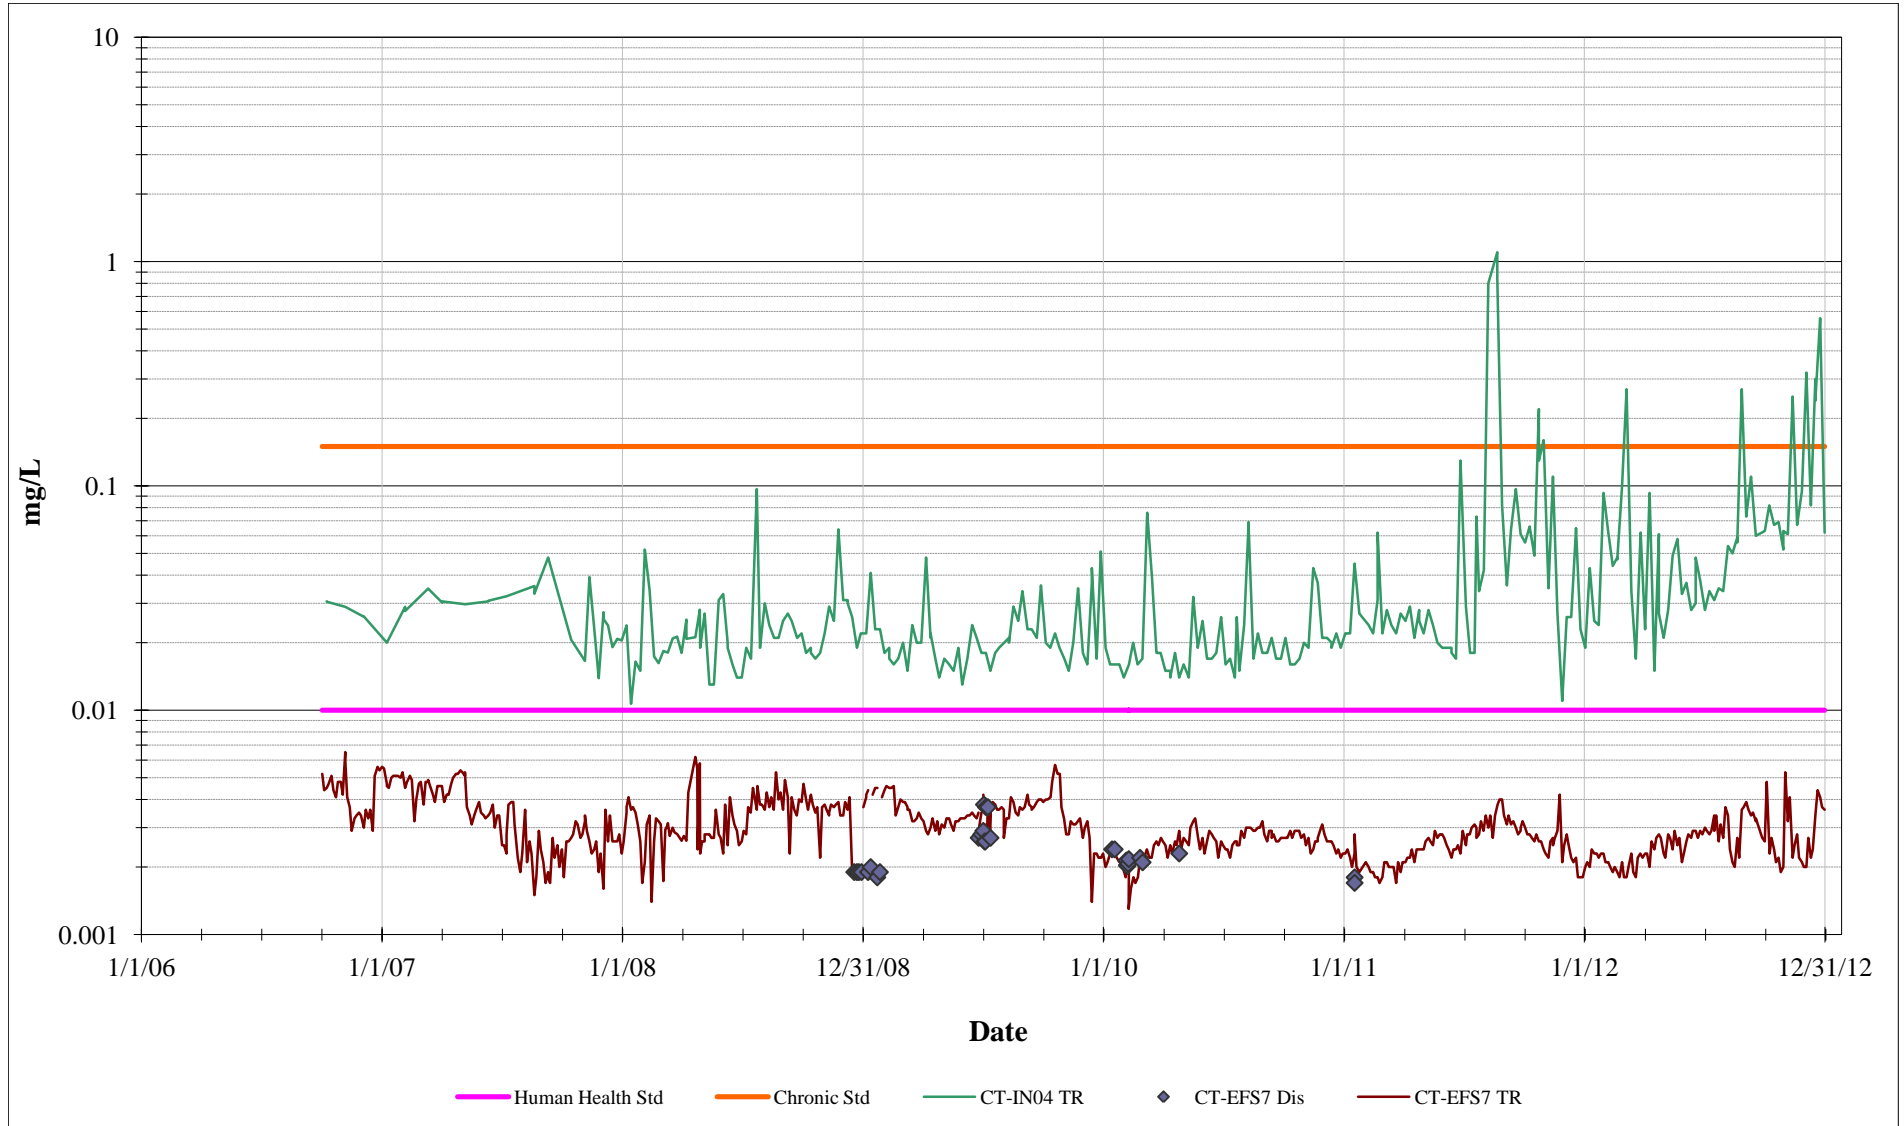


Arsenic maximum standard is the DEQ-7 Human Health standard.

# Butte Treatment Lagoon System Cadmium Concentration

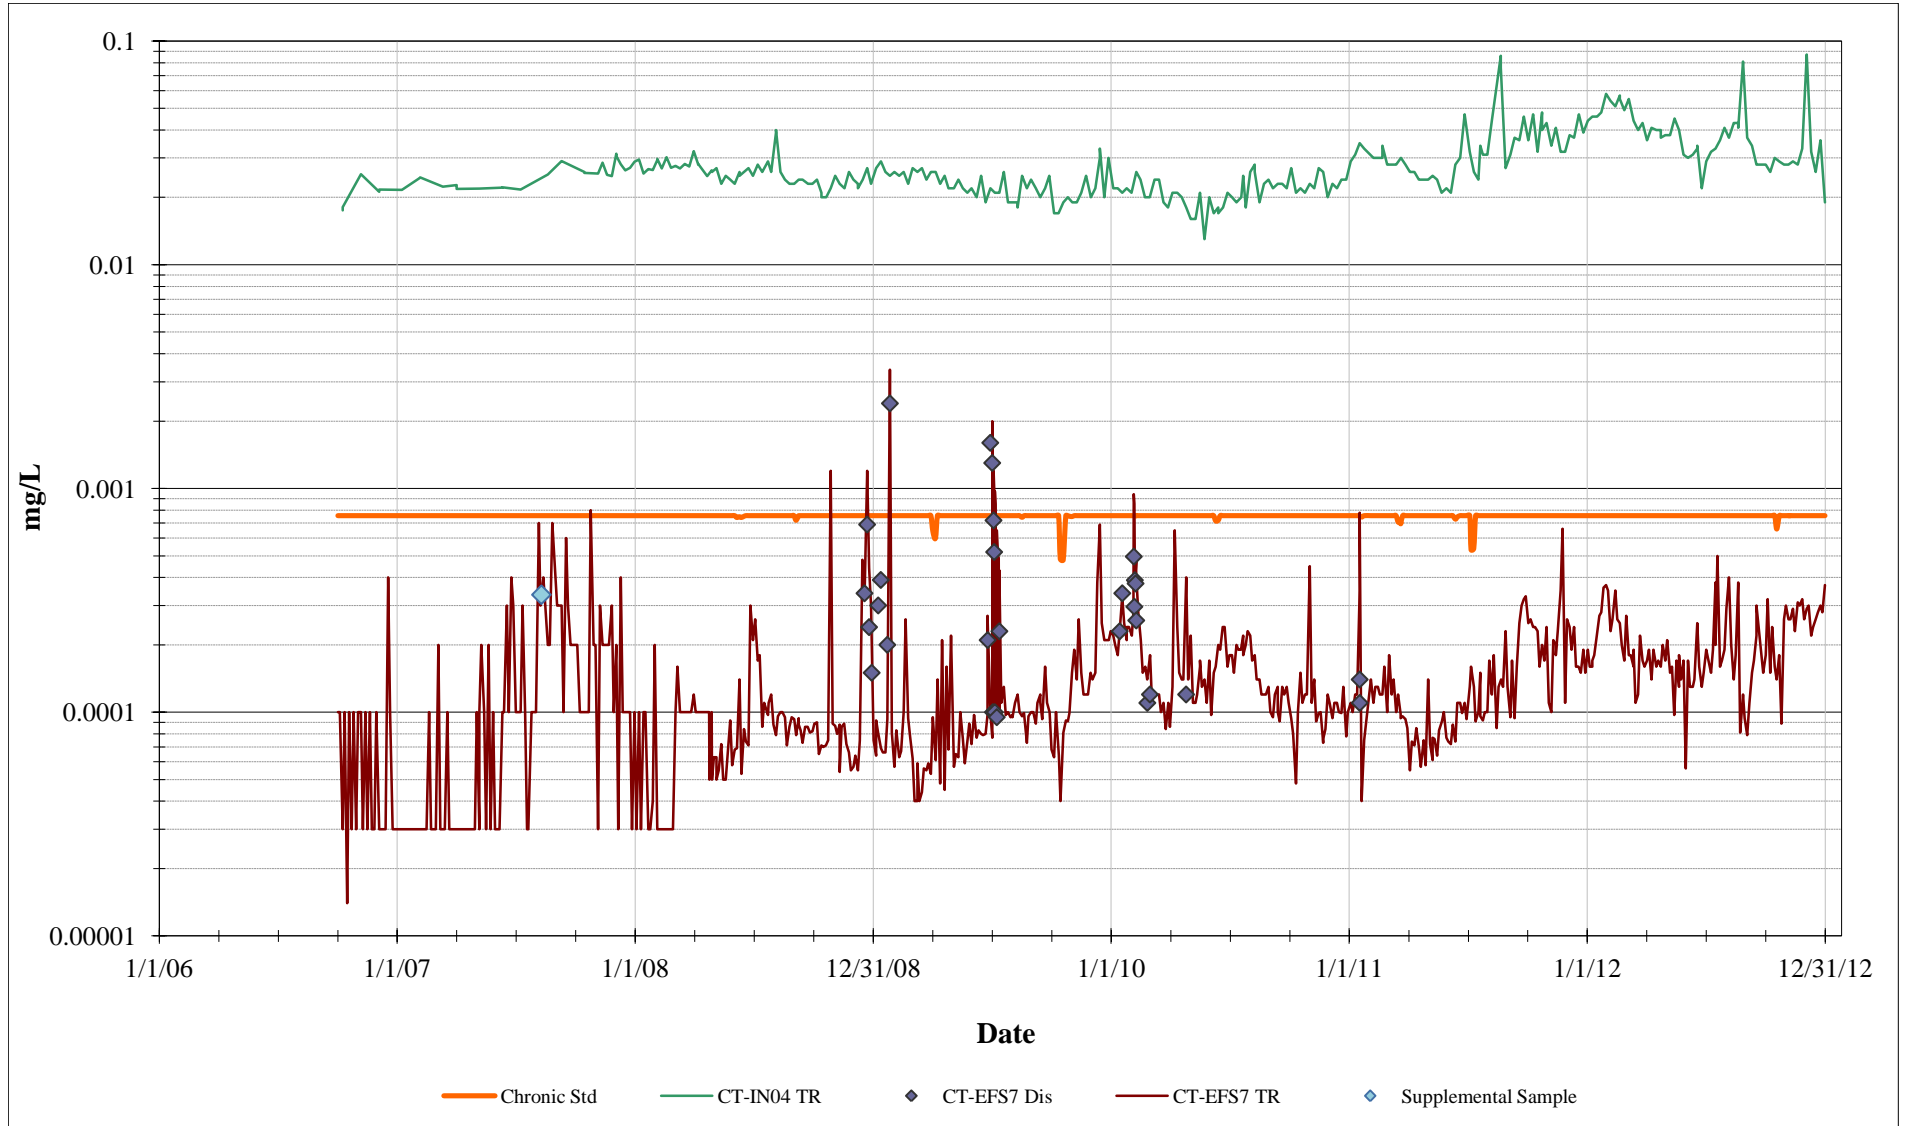


Cadmium maximum standard is DEQ-7 Chronic Aquatic standard which is calculated from effluent (CT-EFS7) hardness.

# Butte Treatment Lagoon System Copper Concentration

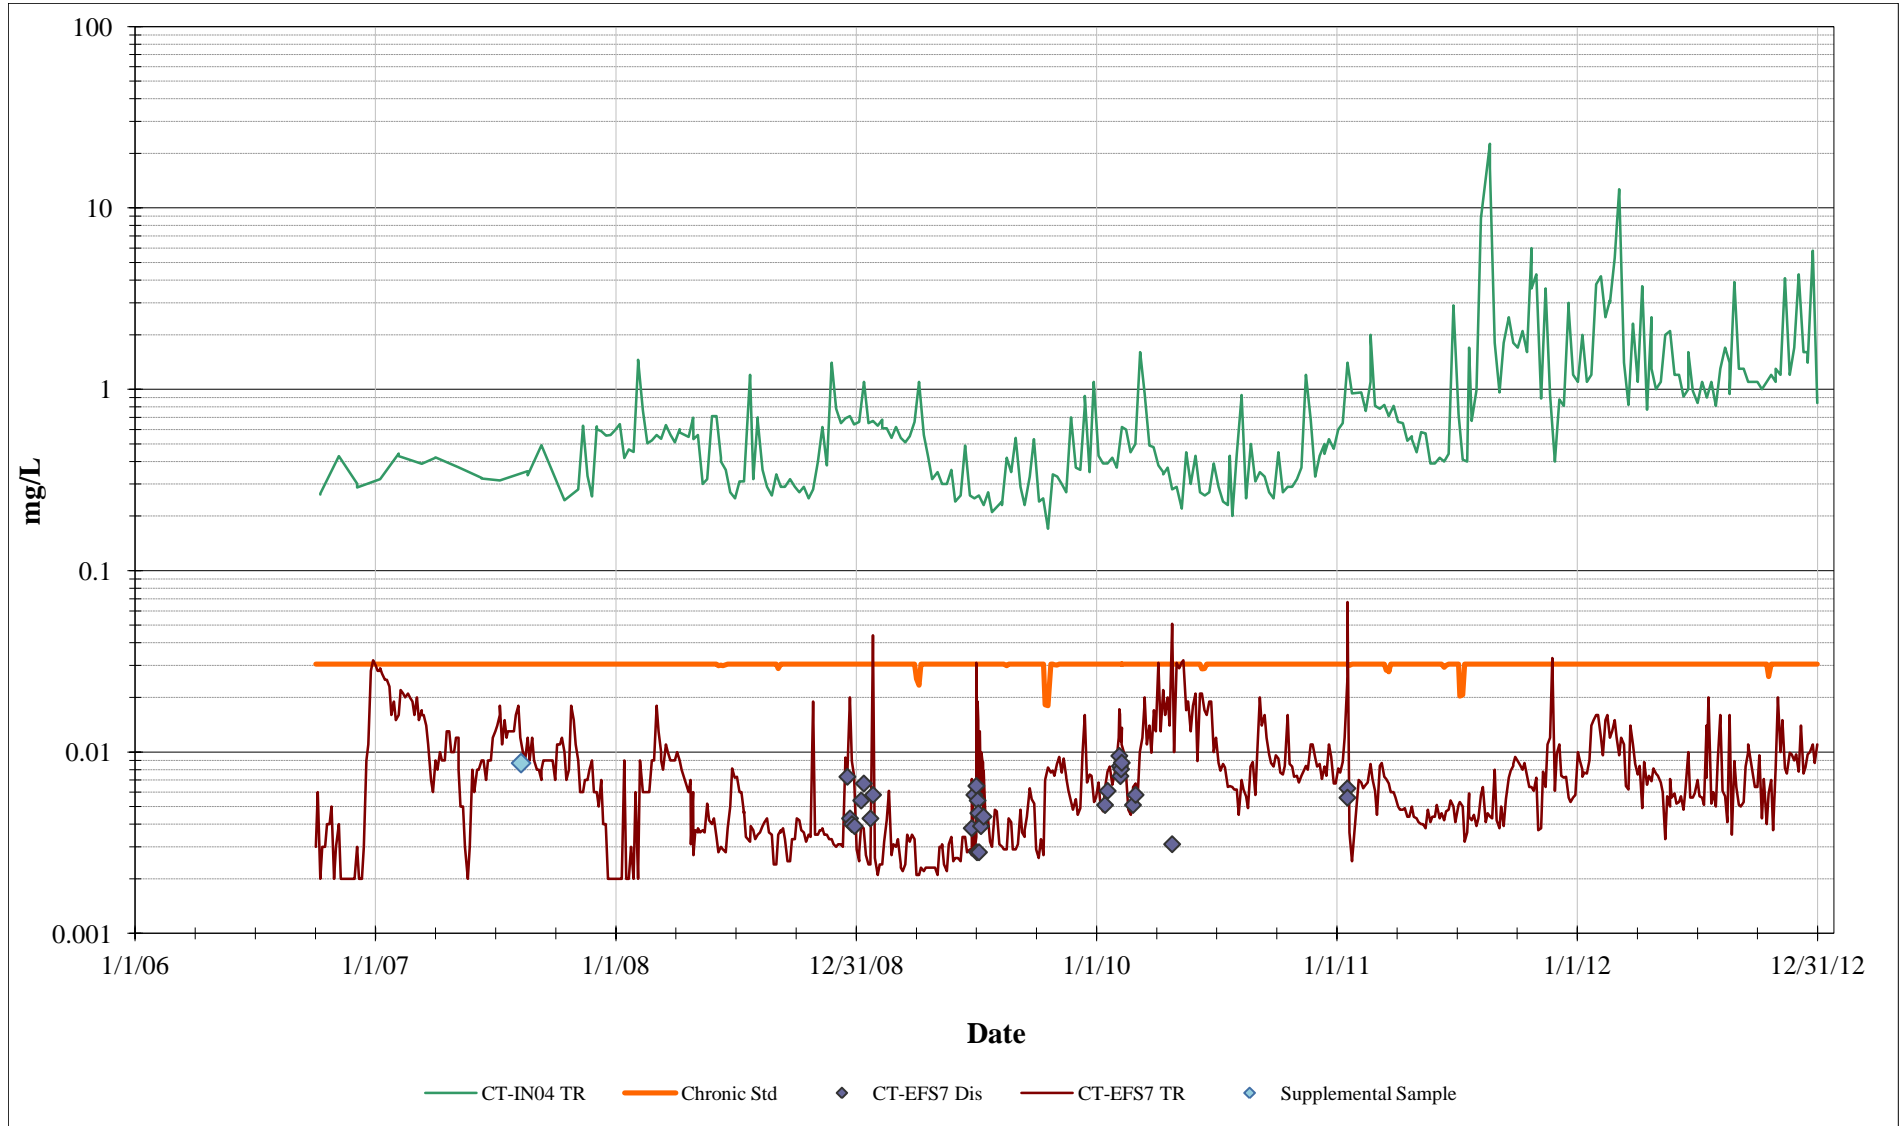


Copper maximum standard is DEQ-7 Chronic Aquatic Life standard which is calculated from effluent (CT-EFS7) hardness.

# Butte Treatment Lagoon System Lead Concentration

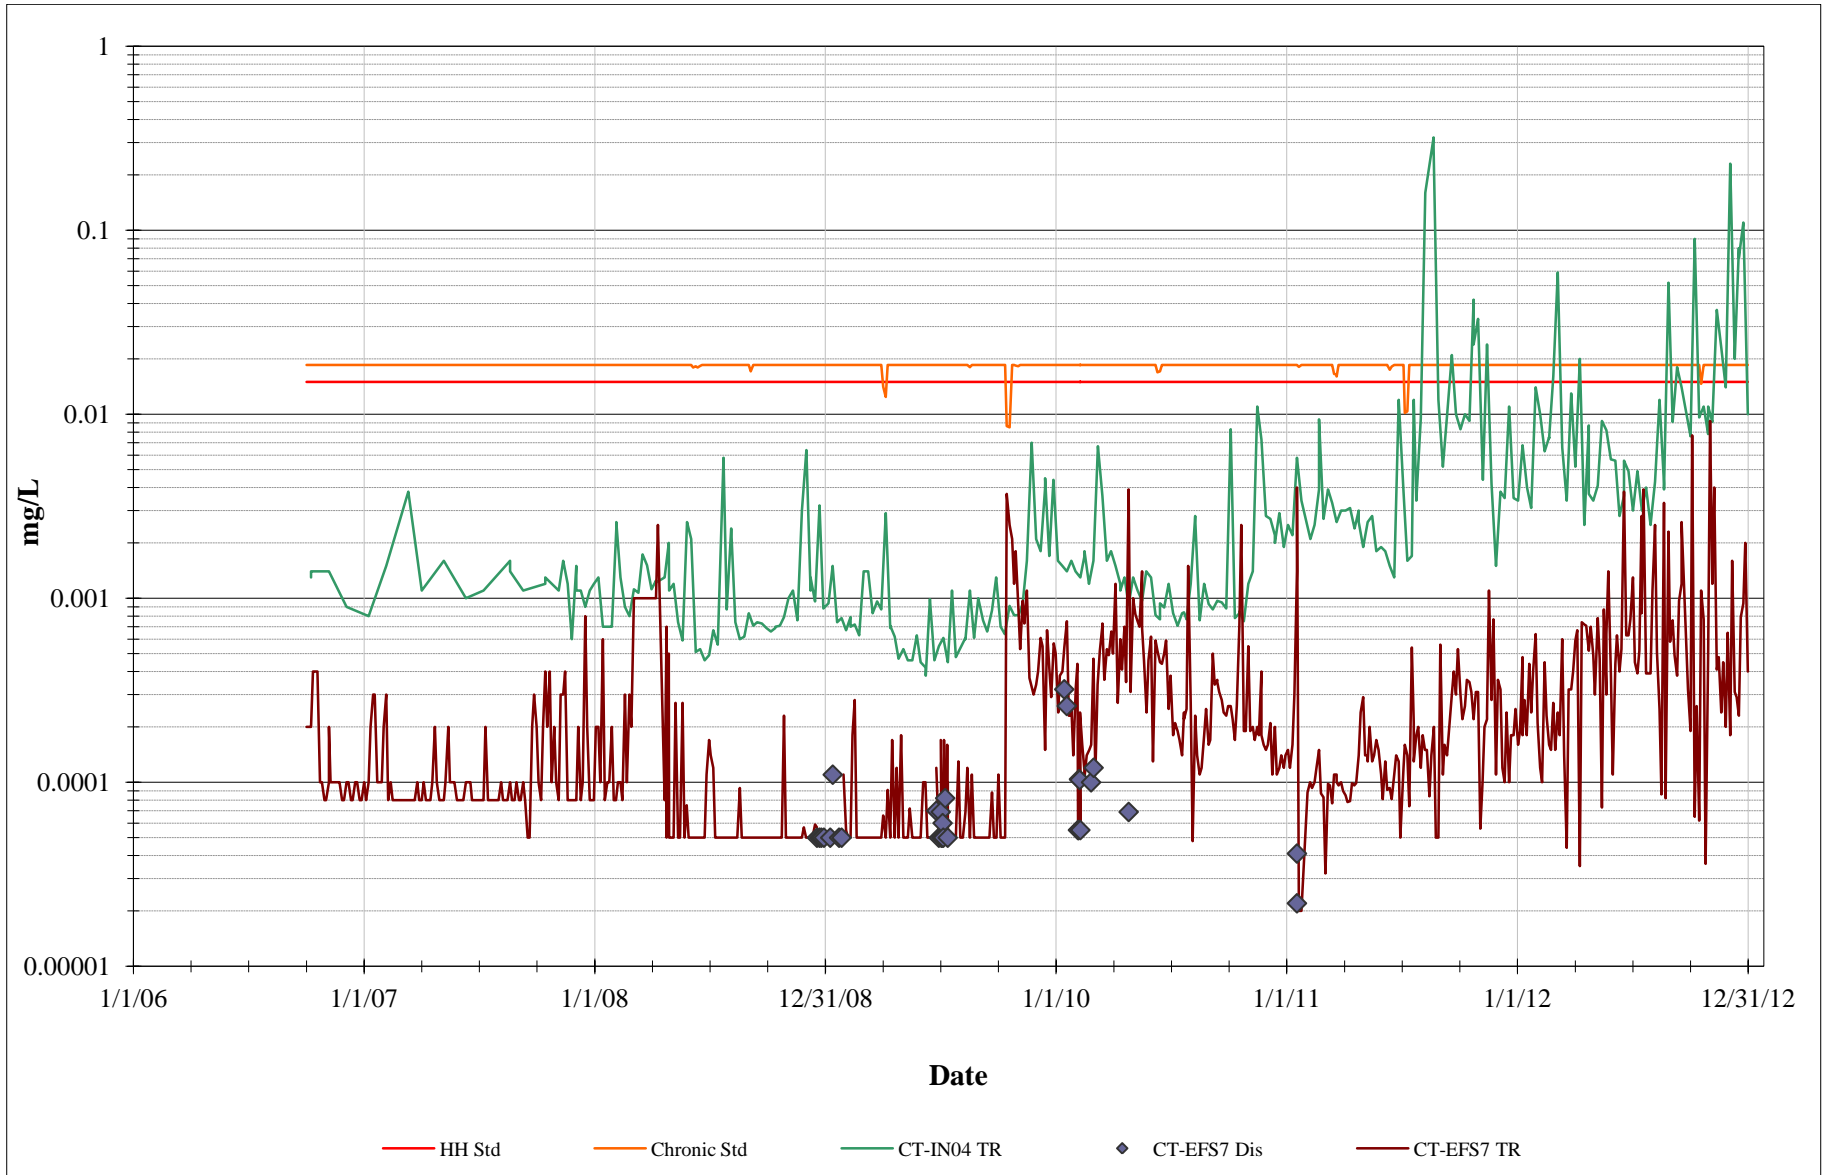


Lead maximum standard is DEQ-7 Human Health standard which is calculated from effluent (CT-EFS7) hardness.

# Butte Treatment Lagoon System Mercury Concentration

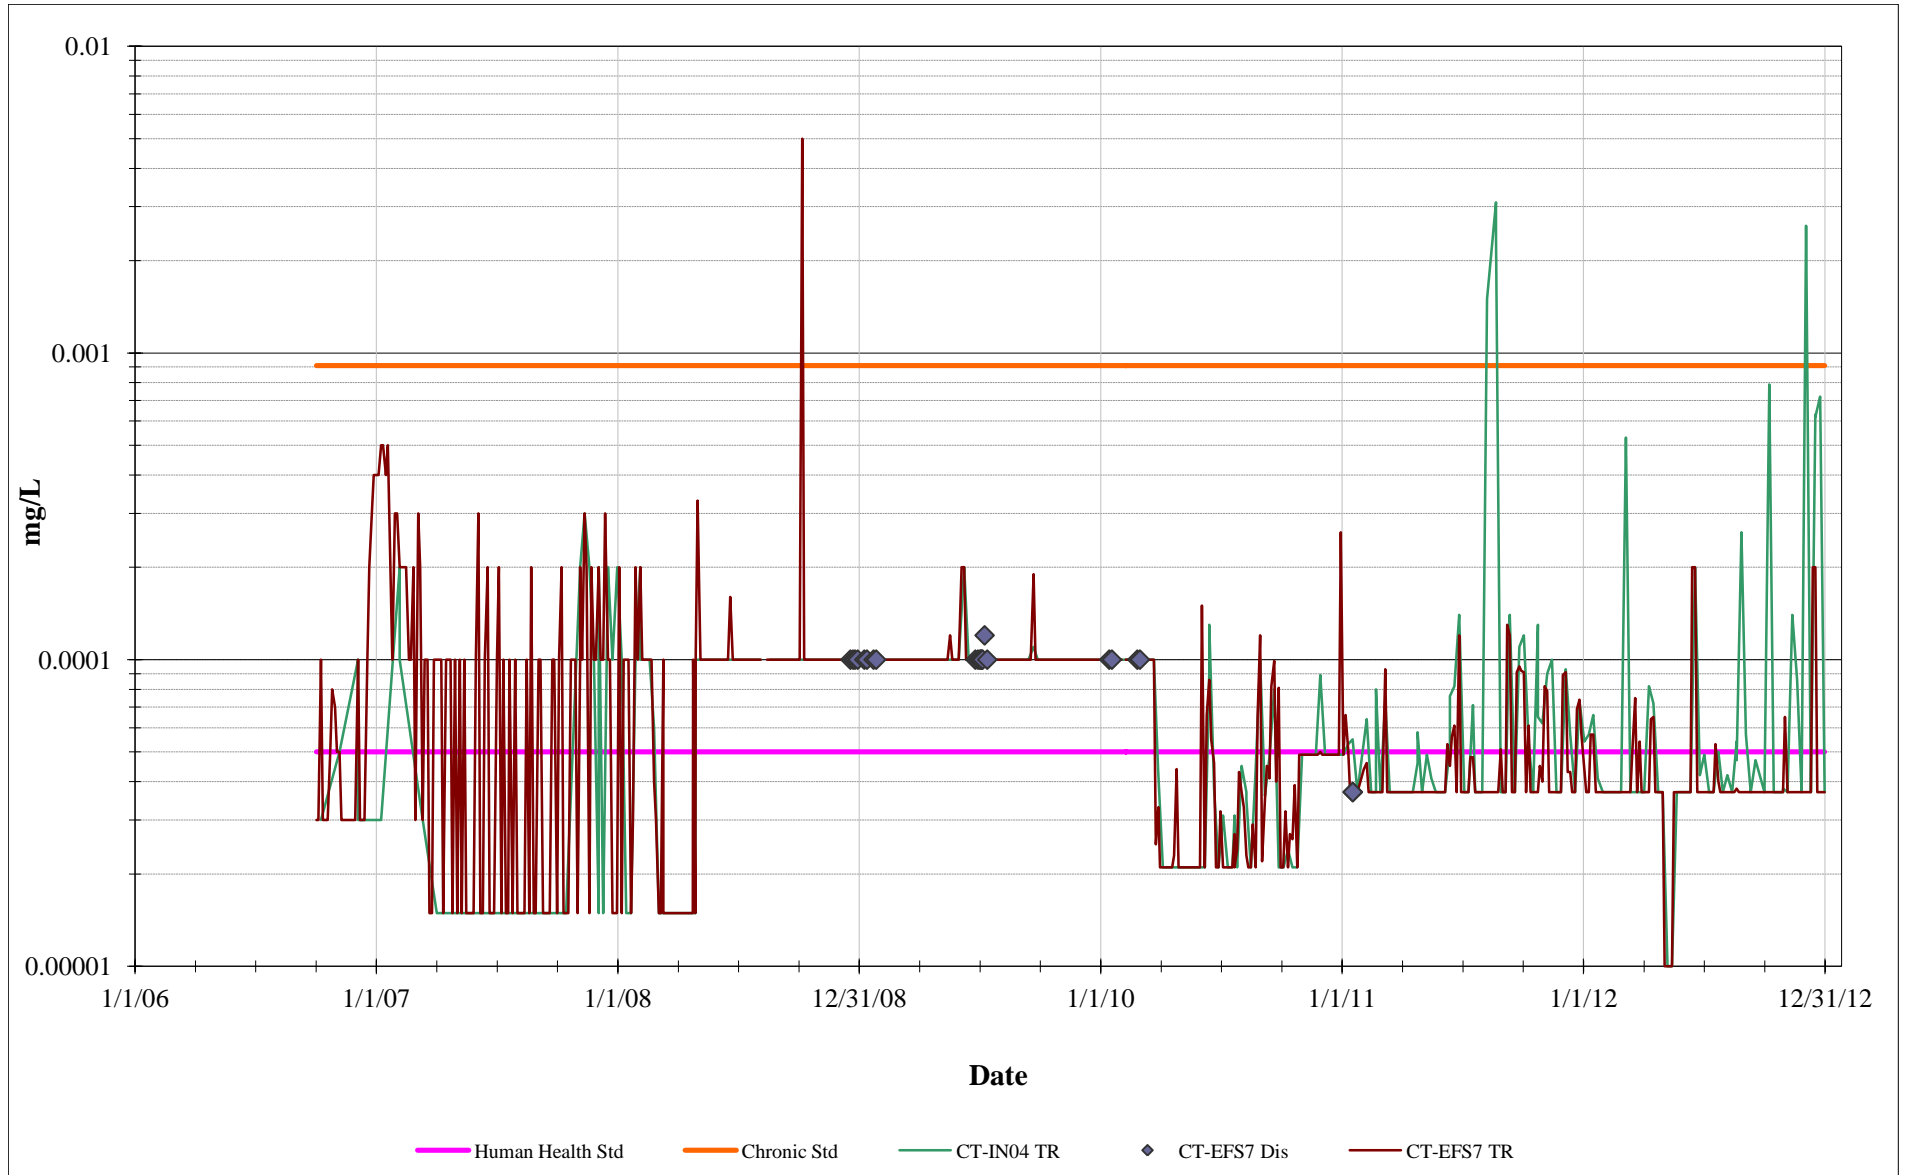

Mercury maximum standard is DEQ-7 Human Health standard.

# Butte Treatment Lagoon System Zinc Concentration

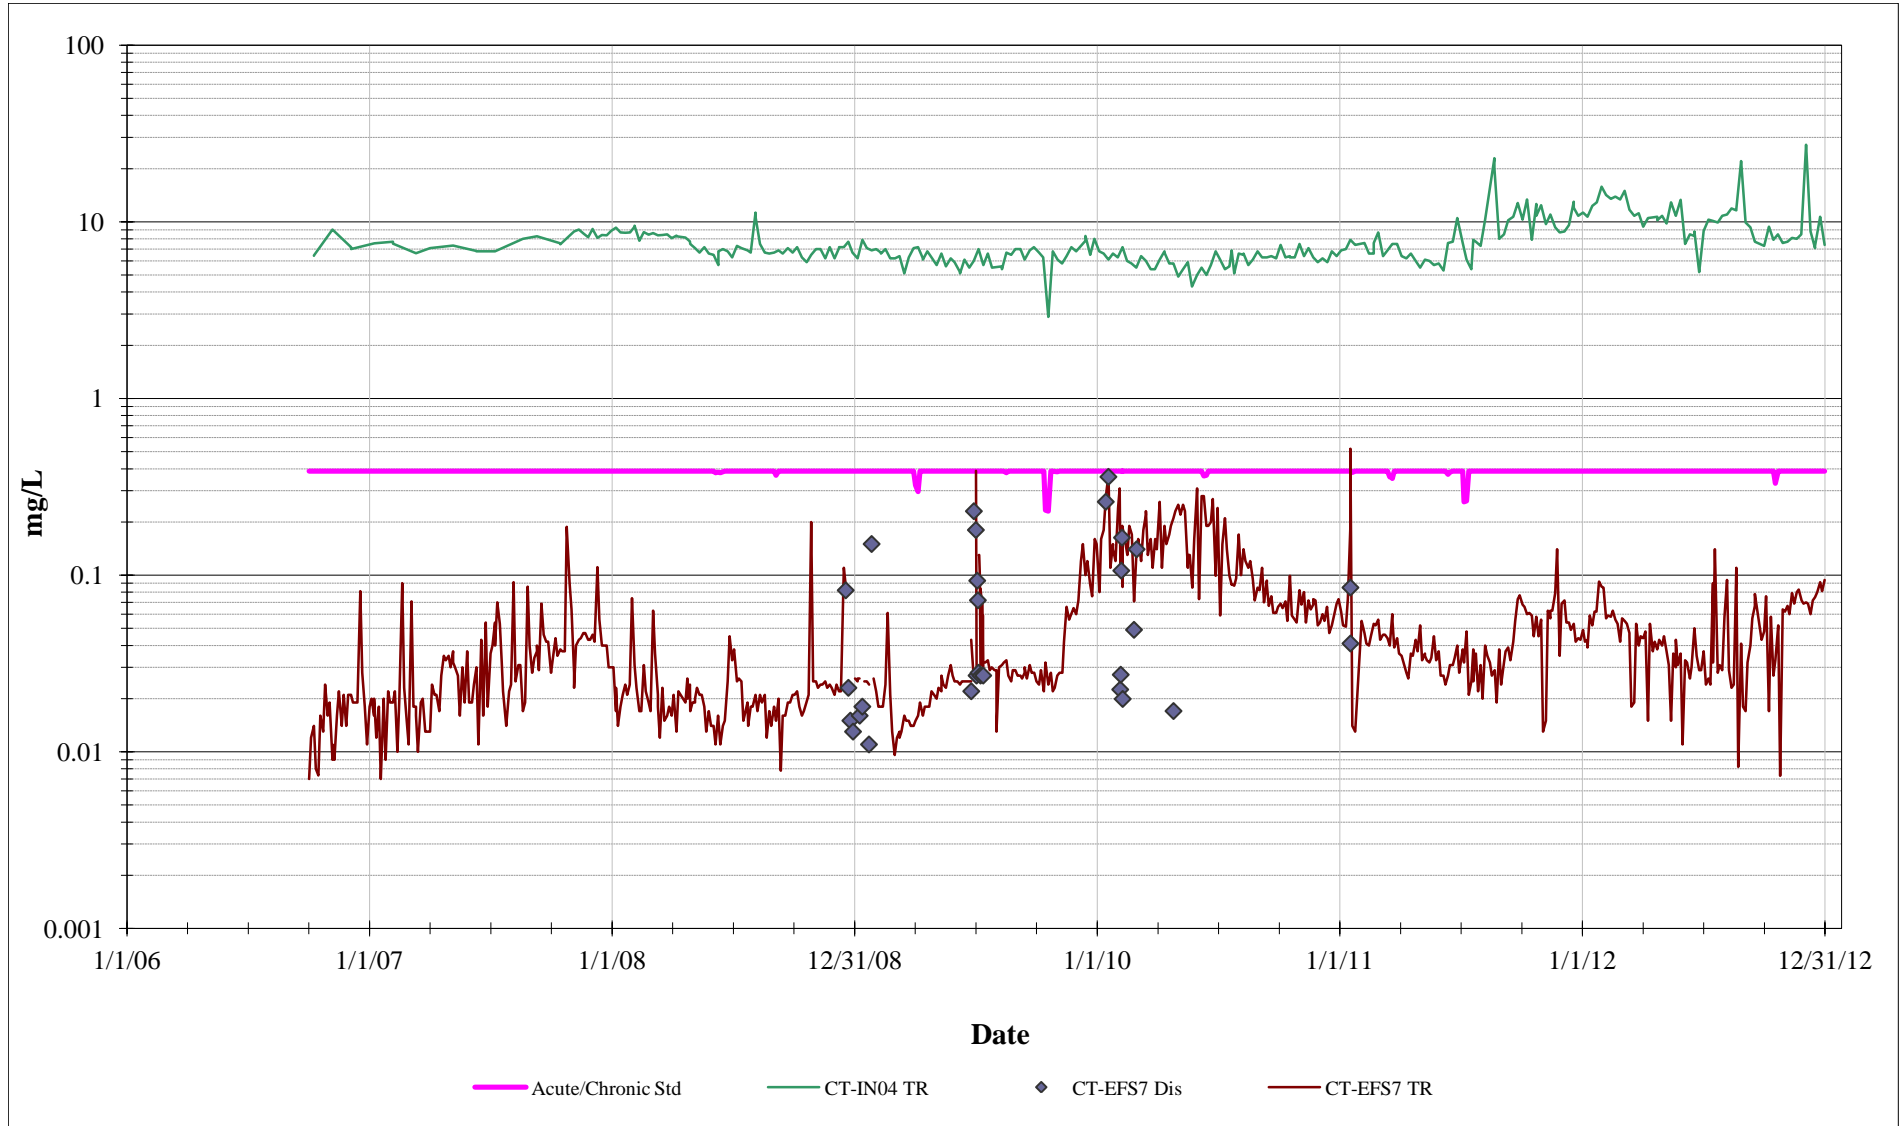

Zinc maximum standard is DEQ-7 Acute/Chronic standard which is calculated from effluent (CT-EFS7) hardness.